

C-25

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS, DELHI FIRE SERVICE, NEW DELHI

No. F6/DFS/MS/EH/SZ/2026/ 594

Dated: 129/06 /2026

To,

The Commissioner MCD,
Civic Centre, Minto Road,
New Delhi- 110002.

Sub: Regarding issuance of FSC from fire safety point of view in r/o. M/s. Haldiram Marketing (A Unit of Haldiram marketing Pvt. Ltd). Located at M-35, Block-M, GF, FF, SF & TF, Greater Kailash, New Delhi-110048.

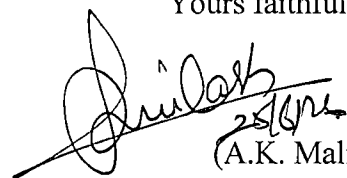
Sir,

Please refer to your online application no. No. 2026052507435 dated- 25/05/2026, on the subject cited above. In this connection, it is to inform you that the premises was inspected by officer concerned of this department on 15/06/2026 in the presence of Sh. Rahul Agarwal (AGM,Operation). During inspection, the following shortcomings were observed.

1. One stair of width 1.5 meter is provided against requirement of 2x1.5meter each in basement.
2. Smoke management system is not provided.
3. Fire Check Door is not provided at basement.
4. Firefighting pump 2x1620 lpm is provided against requirement of 2x 2280lpm.
5. Underground water tank of capacity of 20,000 liter is provided against requirement of 1lakh liter
6. Draw- off connection & fire service inlet is not provided.

In view of above Shortcomings, the application for issuance of fire safety certificate is cannot considered at this stage & rejected. The occupancy of the building/premises in absence of requisites fire safety arrangements shall be at the risk and liabilities of the Owner/occupier.

Yours faithfully,


(A.K. Malik)
Chief Fire Officer

Copy to: -

1. The authorized signatory, M/s Haldiram Marketing (A Unit of Haldiram marketing Pvt. Ltd). Located at M-35, Block-M, GF, FF, SF & TF, Greater Kailash, New Delhi-110048. (Online application No. 2026052507435 dated- 25/05/2026).