



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001



No. F6/DFS/MS/School/NDZ/2025/913

Dated: 25/07/2025

FIRE SAFETY CERTIFICATE

Certified that the **Amity International School** located at **Mayur Vihar Phase - 1, Delhi - 110091** comprised of **Basement + Ground + 04 Upper floors**, owned/occupied by Amity International School, was granted FSC by this department vide letter No. F6/DFS/MS/School/NDZ/2022/868 dated 10/08/2022. The premises was re-inspected by the officers concerned of this department on 10/07/2025 in the presence of the Mr. Sunil Pandit (Admin Officer) and found that the said school building have deemed complied with the fire prevention and fire safety requirements in accordance with the Rule 33 of the Delhi Fire Service Rules 2010 and that the premises is fit for occupancy class "**B**" '**Educational Building**' **Basement + Ground + 04 Upper floors** with effect from 25/07/2025 for a period of **three years**, subject to conditions, printed below.

Issued on 25/07/2025 at New Delhi by.


(VIRENDRA SINGH)
CHIEF FIRE OFFICER
DELHI FIRE SERVICE

Copy to: -

1. The Director Education, D - Block, Anand Vihar, Delhi - 110091.
2. The Principal, Amity International School located at Mayur Vihar Phase - 1, Delhi - 110091.

Condition for the validity of fire safety certificate

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
7. The means of escape shall be kept unobstructed / unlocked for unhindered evacuation in case of an emergency.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six months prior to its expiry".

INSPECTION REPORT

INSPECTION REPORT

1. Name & address of the building Amity International School at Mayur Vihar Phase-1, Delhi - 110091
2. Type of occupancy: - Educational Group-B
B + Gr. + 04 Upper floors
3. Type of case: - Renewal
4. Details of previous FSC:- F6/DFS/MS/School/NDZ/2022/868 dt 10/08/2022
5. Fire safety directives No.- NBC Part - IV
6. Date of inspection: - 10/07/2025
7. Name of the inspecting officer: - Yashwant Singh Meena (ADO/LN) & Ashok Kumar Jaiswal DO/East)
8. Name & designation of officer
From the building side: - Mr. Sunil Pandit (Admin Officer)
9. Year of construction: - 2005
10. Applicant's letter No: - Outdoor Diary No. Nil dated 20/06/2025

S.No.	Minimum Standards on fire Prevention and fire safety U/R 33	Requirement	Provided at site	Remarks MR/NMR
1.	Access to Building			
	1) Road width	06 mtr.	15 mtr.	MR
	2) Gate width	6 mtr.	6 mtr.	MR
	3) Width of internal road	6 mtr.	6 mtr.	MR
2.	Number, Width Type & Arrangement of Exits			
	A. Number of staircases			
	1. Upper floors	03 no.	03 nos.	MR
	2. Basements	02 no.	02 nos.	MR
	B. Width of staircase			
	1. Upper floors	1.50 m	1.50 mtr. each	MR
	2. Basements	1.50 m	1.50 mtr. each	MR
	C. Protection of exits			
	1. Fire check door	N/A	N/A	N/A
	2. Pressurization	N/A	N/A	N/A
	D. No. of continuous staircase to terrace	02 nos.	02 nos.	MR
	E. Width of corridor	1.5 mtr.	2.0 mtr.	MR
	F. Door size	1.0 mtr.	1.0 mtr.	MR
3.	Compartmentation			
	1) Fire check door	N/A	N/A	N/A
	2) Sealing of electrical shafts	Required	Sealed	MR
	3) Fire rating of shaft door	N/A	N/A	N/A
	4) Water curtain	N/A	N/A	N/A
	5) Fire Dampers	N/A	N/A	N/A
4.	Smoke Management System			
	1) Basements	Exhaust fan	Provided	MR
	2) Upper floors	N/A	N/A	N/A
5.	Fire Extinguishers			
	1) Total numbers	25 Nos.	30 Nos.	MR
	2) Types	ABC & CO2	ABC & CO2	MR
	3) ISI marking	ISI marked	ISI marked	MR


N/33


6.	First-Aid Hose Reel			
	1) Total number of each floor	02 nos.	02 nos.	MR
	2) Length of hose reel hose	30 m	30 mt	MR
	3) Nozzle diameter	05 mm	05 mm	MR
7.	Automatic Fire Detection & Alarming System			
	1) Type of detectors	N/A	N/A	N/A
	2) Location of main panel	N/A	N/A	N/A
	3) Location of repeater panel	N/A	N/A	N/A
	4) Alternate source of power	N/A	N/A	N/A
	5) Hooter's Location	N/A	N/A	N/A
8.	MOEFA	Required	Provided	MR
9.	Public Address System	N/A	Provided	N/A
10.	Automatic Sprinkler System			
	1) Basement	Required	Provided	MR
	2) Upper floors	N/A	N/A	N/A
	3) Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	1) Size of riser/down-comer	100 mm	100 mm	MR
	2) Number of hydrants per floor	2 no.	2 no.	MR
	3) Hose box	2 no.	2 no.	MR
12.	Yard Hydrants			
	1) Total number of hydrants	N/A	N/A	N/A
	2) Hose box	N/A	N/A	N/A
13.	Pumping Arrangement			
	1) Ground level	N/A	N/A	N/A
	a) Discharge of main pump	N/A	N/A	N/A
	b) Head of main pump	N/A	N/A	N/A
	c) Number of main pumps	N/A	N/A	N/A
	d) Jockey pump out put	N/A	N/A	N/A
	e) Jockey pump head	N/A	N/A	N/A
	f) Stand by pump output	N/A	N/A	N/A
	g) Stand by pump head	N/A	N/A	N/A
	h) Auto starting/Manual stopping	N/A	N/A	N/A
	2) Terrace level			
	a) Discharge of pump	450 LPM	900 LPM	MR
	b) Head of pump	40 m	40 m	MR
	c) Power supply	Required	Provided	MR
	d) Auto starting of pump	Required	Provided	MR
14.	Captive Water Storage for Fire Fighting			
	1) Underground tank capacity	N/A	1,00,000 liters.	N/A
	a) Draw-off connection	N/A	N/A	N/A
	b) Fire service inlet	N/A	N/A	N/A
	c) Access to tank	N/A	N/A	N/A
	d) Over head tank capacity	25,000 liters.	25,000 liters.	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	a) Pressurization of lift shaft	N/A	N/A	N/A
	b) Pressurization of lift lobby	N/A	N/A	N/A
	c) Communication in lift car	N/A	N/A	N/A

	d) Fireman's switch	N/A	N/A	N/A
	e) Lift signage	N/A	N/A	N/A
17.	Stand by Power Supply	N/A	N/A	N/A
18.	Refuge Area	N/A	N/A	N/A
	Total area location	N/A	N/A	N/A
19.	Fire Control Room	N/A	N/A	N/A
	a) Detector system panel	N/A	N/A	N/A
	b) Flow switch panel	N/A	N/A	N/A
	c) PA system panel	N/A	N/A	N/A
	d) Battery backup	N/A	N/A	N/A
	e) Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risk, if any:			N/A


The fire protection system provided in the school building were tested, checked at random and found functional at the time of inspection.

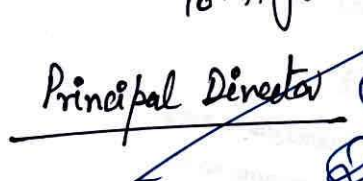
In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the FSC issued vide letter F6/DFS/MS/School/NDZ/2022/868 dated 10/08/2022, renewal under Rule 35 of the Delhi Fire Service rules 2010, is recommended.



Signature of the Inspecting Officer
Name: Yashwant Singh Meena
Designation: ADO /Laxmi Nagar



Signature of the Inspecting Officer
Name: Ashok Kumar Jaiswal
Designation: Divisional Office/ East


Dy C.F.O. (NDZ) L.V.P.
14/07/25



C.F.O.
18/7/2025


Principal Director
CFO may leave.
21/07/25


C.F.O.
22/7/2025


DO (East)
23.7.2025
ADTLN.

Six F.T Letter is put up for sign. Please


C.F.O.
24/7/2025

MS Cell


23/7/2025