

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE

NEW DELHI- 110001

No. F6/DFS/MS/School/2025/SZ/48

Dated: 22/01/2025

FIRE SAFETY CERTIFICATE

Certified that the **Bholi Ram Public school** is running at ground & first floor only in a building of two blocks Old Block & New Block, both blocks comprised of ground plus two upper floors located at E-57 To 69, Indira Park, Najafgarh, New Delhi- 110043, owned/occupied by Bholi Ram Public School, was issued FSC vide letter No. F.6/DFS/MS/school/2021/SZ/1003 dated 10.12.2021. The school building was inspected by the officer concerned of this department on dated 13.01.2025 in the presence of Sh. Pardeep Kumar (Principal) and found that the school management have deemed complied with the fire prevention and fire safety requirements in accordance with the Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01-03-2011 issued by the Director of Education and that the building/ premises (**ground and first floor only**) is fit for occupancy class "**Educational Building**" w.e.f. 22/01/2025 for a period of three years, subject to compliance of the conditions printed as under.

Issued on 22/01/2025 at New Delhi by.

(Atul Garg)
Director

Delhi Fire Service

Copy to: -

1. The Principal, Bholi Ram Public school located at E-57 To 69, Indira Park, Najafgarh, New Delhi- 110043.
2. Director of Education, GNCT of NCT of Delhi, Old Secretariat, New Delhi- 110054.

Conditions for the validity of fire safety certificate: -

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

N/12

INSPECTION REPORT

1. Name & address of the building : Bholi Ram Public school, E-57 To 69, Indira Park, Najafgarh, New Delhi-43.
2. Building is comprised of : Two blocks (Old & New) each block having ground plus two upper floors & both blocks are **interconnected** at all floors. But school is running at Ground & First floor only.
3. Type of Occupancy : Educational
4. Type of Case : Renewal
5. Details of Previous NOC : F.6/DFS/MS/school/2021/SZ/1003 dated 10.12.2021
6. Fire Safety direction letter No : F.16/Estate/CC/Fire Safety/2011/3298 dated 01.03.2011
7. Date of Inspection : 13.01.2025
8. Name of the Inspecting Officers: : ADO R.K. Yadav (JKP)
9. Name of the designation of Officer
from the building side : Sh. Pardeep Kumar (Principal)
10. Year of Construction : Old Block (Before 2008) & New Block (2015)
11. Applicant's letter No : BRPS/22/18 dated 12.12.2024

Sr. No.	Minimum Standards on fire prevention and fire safety requirements U/R 33	DOE Dated 1.3.2011 (Rule 35(e))	Provided at Site	Remarks MR/NMR
1	Access to building			
	Road width	6 m	06 m	MR
	Gate width	4.5	Direct accessible from road	MR
	Width of internal road	N.A.	N.A.	N.A.
2	Number, Width, Type and Arrangement of Exits			
	a. Number of Staircases			
	Upper Floor	2 nos.(Old Blk) 01 no.(New Blk)	2 nos. (Old Blk) 01 no. (New Blk)	MR(Old Accepted)
	Basement	N.A.	N.A.	N.A.
	B. Width of Staircases			
	Upper Floor	1.5&1.31 m (old Blk) &1.54 m (New blk)	1.5&1.31 m (old Blk) & 1.35m (New blk)	MR (Old Accepted)
	Basement	N.A.	N.A.	N.A.
	c. Protection of exits			
	Fire check door	N.A.	N.A.	N.A.
	Pressurization	N.A.	N.A.	N.A.
	e. No. of continuous staircases to terrace	N.A.		
	g. Width of Corridor	2 no.	2 no.	MR
	h. Door Size	1.5 m	1.50 m	MR
		1 m	.90 to 1.19 m	MR being old case
3	Compartmentation.			
	Fire check door	N.A.	N.A.	N.A.
	Sealing of electrical shafts	N.A.	N.A.	N.A.
	Fire rating of shaft door	N.A.	N.A.	N.A.
	Water curtain	N.A.	N.A.	N.A.
	Fire Dampers	N.A.	N.A.	N.A.
4	Smoke Management System.			
	Basement	N.A.	N.A.	N.A.
	Upper floor	Required	Natural ventilation	MR


5.	Fire Extinguisher			
	Total numbers	08 Nos.	16 Nos.	MR
	types	CO ₂ & ABC	CO ₂ & ABC	MR
	IS marking	ISI marked	ISI marked	MR
6	First-aid-Hose Reels.			
	Total numbers of each floor	N.A.	N.A.	N.A.
	Length of hose reel hose	N.A.	N.A.	N.A.
	Nozzle diameter	N.A.	N.A.	N.A.
7	Automatic fire detection and alarming system.			
	Type of detectors	N.A.	N.A.	N.A.
	Location of main panel	N.A.	N.A.	N.A.
	Location of repeater panel	N.A.	N.A.	N.A.
	Alternate source of power	N.A.	N.A.	N.A.
	Hooters	N.A.	N.A.	N.A.
8	MOEFA	N.A.	N.A.	N.A.
9	Public address System.	N.A.	N.A.	N.A.
10	Automatic Sprinkler System.			
	basement	N.A.	N.A.	N.A.
	upper floor	N.A.	N.A.	N.A.
	sprinkler above false ceiling	N.A.	N.A.	N.A.
11	Internal Hydrants			
	size of riser/down-comer	N.A.	N.A.	N.A.
	Number of hydrants per floor	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
12	Yard Hydrants.			
	Total number of hydrants	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
13	Pumping Arrangements.			
	• Ground Level	N.A.	N.A.	N.A.
	➤ Discharge of main Pump	N.A.	N.A.	N.A.
	➤ Head of Main Pump	N.A.	N.A.	N.A.
	➤ Number of main pumps	N.A.	N.A.	N.A.
	➤ Jockey pump out put	N.A.	N.A.	N.A.
	➤ Jockey pump head	N.A.	N.A.	N.A.
	➤ Standby pump out put	N.A.	N.A.	N.A.
	➤ Standby pump Head	N.A.	N.A.	N.A.
	➤ Auto Starting /Manual stopping	N.A.	N.A.	N.A.
	➤ Pump House Access	N.A.	N.A.	N.A.
	• Terrace Level			
	➤ Discharge of pump	N.A.	N.A.	N.A.
	➤ Head of the Pump	N.A.	N.A.	N.A.
	➤ Power supply	N.A.	N.A.	N.A.
	➤ Auto Starting of pump	N.A.	N.A.	N.A.
14	Captive Water Storage for Fire Fighting.			
	Underground tank capacity	N.A.	N.A.	N.A.
	Draw-off connection	N.A.	N.A.	N.A.
	Fire service inlet	N.A.	N.A.	N.A.
	Access to tank	N.A.	N.A.	N.A.
	Overhead Tank capacity	N.A.	N.A.	N.A.
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			

	Pressurization of Lift Shaft	N.A.	N.A.	N.A.
	Pressurization of Lift lobby	N.A.	N.A.	N.A.
	Communication in lift car	N.A.	N.A.	N.A.
	Firemen's grounding switch	N.A.	N.A.	N.A.
	Lift Signage	N.A.	N.A.	N.A.
17	Standby power supply	N.A.	N.A.	N.A.
18	Refuge Area.			
	Total area	N.A.	N.A.	N.A.
	Location	N.A.	N.A.	N.A.
19	Fire Control Room			
	Detector system panel	N.A.	N.A.	N.A.
	Flow switch panel	N.A.	N.A.	N.A.
	PA system panel	N.A.	N.A.	N.A.
	Batter backup	N.A.	N.A.	N.A.
	Building Floor Plans	N.A.	N.A.	N.A.
20	Special Fire Protection systems for protection of special Risks, if any:	N.A.	N.A.	N.A.

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the FSC issued vide letter No. F.6/DFS/MS/school/2021/SZ/1003 dated 10.12.2021, renewal under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

Note: - As per affidavit submitted by Principal placed at (C-31), the building is comprised of ground plus two upper floors but school is running at ground & first floor only.



 Signature of the Inspecting Officer
 Name: - R. K. Yadav
 Designation: - ADO (JKP)

DO (South West)

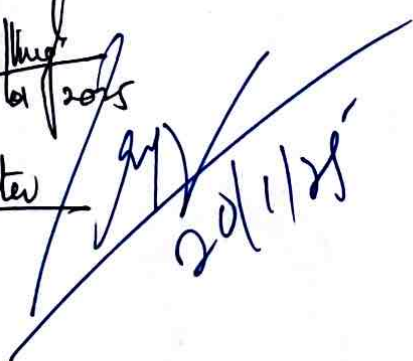


17/11/25

CFO


20/11/25

Director


20/11/25

