



FORM 'H' : FORM FOR ISSUING FIRE SAFETY CERTIFICATE

[See sub-rule (1) of rule 35]

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE

NEW DELHI- 110 001

No.F.6/DFS/MS/College/2026/NDZ/17

Dated: 24/01/2026

FIRE SAFETY CERTIFICATE

Certified that the **Block A, Block B, Block C & Auditorium**, at **East Delhi Campus Guru Gobind Singh University, Surajmal Vihar, Shahdara, Delhi-110032**, building comprising of **Auditorium** (Two Basement, Ground + 04 upper floors), **Block A & B** (Two Basement, Ground + 08 upper floors) & **Block C** (Two Basement, Ground + 06 upper floors) owned/occupied by **Guru Gobind Singh University** was issued FSC vide letter No. **Block-A F.6/DFS/MS/2022/NDZ/11** dated 16/08/2022, **Block-B F.6/DFS/MS/2022/NDZ/29** dated 28/12/2022 **Block-C F.6/DFS/MS/2022/NDZ/28** dated 28/12/2022 & **Auditorium Building F.6/DFS/MS/Bnqt./2023/NDZ/College/17** dated 09/06/2023. The premises was re-inspected by the officer concerned of this department on dated 15/01/2026 & 20/01/2026 in the presence of Sh. Abhishek Agarwal (Executive Engineer) & J.E (MCD) and observed that all the fire prevention and fire safety arrangements provided in the premises and found that the said premises having deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit occupancy class "Educational (Block A & B), Business (Block C) & Assembly (Auditorium) with effect from 24/01/2026 for a period of three years in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the DFS rules, 2010.

Issued on 24/01/2026 at New Delhi by.

(Dr. S. K. TOMAR)

DY. CHIEF FIRE OFFICER
DELHI FIRE SERVICE

0/L

To,

1. The Executive Engineer, University Work Division, Guru Gobind Singh University, Sec. 16-C, Dwarka, New Delhi-110078
2. The Executive Engineer (Bldg.) (HQ), Municipal Corporation of Delhi, 9th Floor, Civic Centre, Minto Road, New Delhi.

Conditions for the validity of Fire Safety Certificate:-

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipment shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
5. Construction of lift lobby or installation of Fire curtain in the lift shall be provided by the management within six months failing which Fire Safety Certificate should be treated null & void.
6. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction /unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in
8. The owner / occupier shall apply for renewal of this Fire Safety Certificate of the Director in Form 'J' [sub rule (1) of rule (37)] along with a copy of this Certificate, Six Months prior to its expiry.
9. Basement Shall be used as per NBC Part IV.

1. Name & address of the building : **Block A, Block B, Block C & Auditorium, East Delhi Campus Guru Gobind Singh University, Surajmal Vihar, Shahdara, Delhi-110032**
2. Building is comprised of : **Auditorium (Two Basement, Ground + 04 upper floors), Block A & B (Two Basement, Ground + 08 upper floors) & Block C (Two Basement, Ground + 06 upper floors)**
3. Type of Occupancy : **Educational (Block A & B) Business Block C & Assembly (Group-D)**
4. Type of Case : **Renewal**
5. Details of Previous NOC letter : **Block-A F.6/DFS/MS/2022/NDZ/11 dated 16/08/2022, Block-B F.6/DFS/MS/2022/ NDZ/29 dated 28/12/2022 Block-C F.6/DFS/MS/2022/NDZ/28 dated 28/12/2022 & Auditorium Building F.6/DFS/MS/Bnqt./2023/NDZ/College/17 dated 09/06/2023**
6. Fire Safety directive letter No. : **F.6/DFS/MS/BP/2015/72 Dated 18/03/2015**
7. Date of Inspection : **15/01/2026 & 20/01/2026**
8. Name of the Inspecting officers : **Deepak Kumar, ADO (Tahirpur),**
9. Name and designation of Officer from the building side : **Sh. Abhishek Agarawal (Executive Engineer)**
10. Year of Construction : **2012 & 2022**
- Applicant's letter No : **10116642 dated 14/01/2022**

Sr. No.	Minimum Standards on Fire Prevention and Fire Safety U/R33	Directive Requirement	Provided at Site	Remarks MR/NMR
01	Access to Building			
	• Road width	06 m	30 m & 45 m	MR
	• Gate width	06 m	06 m	MR
	• Width of internal road	06 m	06 m	MR
02	Number, Width, Type and Arrangement of Exits			
	a. Number of Staircases			
	• Upper floor Block A	02 nos.	02 nos.	MR
	• Upper floor Block B	02 nos.	02 nos.	MR
	• Upper floor Block C	02 nos.	02 nos.	MR
	• Upper floor Auditorium	04 nos.	04 nos.	MR
	• Basement Common A,B,C	06 nos.	06 nos. + ramp	MR
	• Auditorium Basement	04 nos.	04 nos.	MR
	B. Width of Staircases			
	• Upper floor Block A	1.50 m	1.80 m	MR
	• Upper floor Block B	1.50 m	1.80 m	MR
	• Upper floor Block C	1.50 m	1.80 m	MR
	• Upper floor Auditorium	02 m	02 m	MR
	• Basement Common A,B,C	1.50 m	1.80 m & 4 m ramp	MR
	• Auditorium Basement	02 m	02 m	MR
	c. Protection of Exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	Required	Provided	MR
	d. No. of Continuous Staircases to Terrace	06 nos.	06 nos.	MR
	e. Width of Corridor	02 m	03 m	MR
	f. Door Size	02 m & 1.20 m	02 m & 1.20 m	MR
03	Compartmentation			
	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	Required	Provided	MR
	• Fire rating of shaft door	Required	Provided	MR
	• Water curtain	Required	Provided	MR
	• Fire dampers	Required	Provided	MR
04	Smoke Management System.			
	• Basement	Required	Mechanical	MR
	• Upper floor	Required	Mechanical	MR
05.	Fire Extinguishers			
	• Total numbers	310 nos.	396 nos.	MR
	• Types	ABC /CO ₂	ABC /CO ₂	MR
	• IS marking	ISI marked	ISI marked	MR

N/180


06	First-Aid-Hose Reels. Block A, Block B, Block C & Auditorium			
	Total numbers on each floor per block & Audi	02 nos. (total 08 nos.)	02 nos. (total 08 nos.)	MR
	• Length of hose reel hose	30 mtr	30 mtr	MR
	• Nozzle diameter	05 mm	05 mm	MR
07	Automatic Fire Detection and Alarming System.			
	• Type of detectors	Heat, Smoke	Provided	MR
	• Location of main panel	G Floor	Provided	MR
	• Location of repeater panel	Guard Room	Provided	MR
	• Alternate source of power	Required	Provided	MR
	• Hooter	Required	Provided	MR
08	MOEFA			
09	Public Address System.			
10	Automatic Sprinkler System.			
	• Basement	Required	Provided	MR
	• upper floor	Required	Provided	MR
	• sprinkler above false ceiling	Required	Provided	MR
11	Internal Hydrants of Block A, Block B, Block C & Auditorium			
	• size of riser/down-comer	150 mm	150 mm	MR
	• Number of hydrants per floor	02 nos. per floor, per block & audi	02 nos. per floor & per block & audi (total 08 nos.)	MR
	• Hose box	02 nos. per floor & per block & audi	02 nos. per floor & per block & audi = (total 08 nos.)	MR
12	Yard Hydrants.			
	• Total number of hydrants	37 nos.	37 nos.	MR
	• Hose box	37 nos.	37 nos.	MR
13	Pumping Arrangements. Common for all blocks			
	➤ Ground Level			
	• Discharge of main pump	2850 lpm x02 & 1650 lpm (Water curtain)	2850 lpm x02 & 1650 lpm (Water curtain)	MR
	• Head of main pump	90 m	90 m	MR
	• Number of main pumps	02 nos.	02 nos.	MR
	• Jockey pump out put	180 lpm	180 lpm	MR
	• Jockey pump head	90m	90m	MR
	• Standby pump out put	2850 lpm	2850 lpm	MR
	• Standby pump head	90m	90m	MR
	• Auto starting /manual stopping	Required	Provided	MR
	• Pump house access	Required	Provided	MR
	➤ Terrace Level			
	• Discharge of pump Block A & B	900 lpm X 2	900 lpm X3 nos.	MR
	• Head of the pump	70 m	70 m	MR
	• Power supply	Required	Provided	MR
	• Auto starting of pump	Required	Provided	MR
14	Captive Water Storage for Fire Fighting.			
	• Underground tank capacity	2,00,00 Ltrs.	2,00,00 Ltrs.	MR
	• Draw-off connection	Required	Required	MR
	• Fire service inlet	Required	Required	MR
	• Access to tank	Required	Required	MR
	• Overhead tank capacity per Block	25,000 Ltrs.	25,000 Ltrs.	MR
15	Exit Signage.			
		Required	Provided	MR

D

16	Provision of Lifts.	Required	Provided	MR
	<ul style="list-style-type: none"> • Pressurization of lift shaft • Pressurization of lift lobby • Communication in lift car • Firemen's grounding switch • Lift signage 	Required	Provided	MR
17	Standby Power Supply	Required	Provided	MR
18	Refuge Area. For Block-A & Block-B	70 sqm 6 th floor	70 sqm 6 th floor	MR
19	Fire Control Room	Required	Provided	MR
	<ul style="list-style-type: none"> • Detector system panel • Flow switch panel • PA system panel • Battery backup • Building floor plans 	Required Required Required Required Required	Provided Provided Provided Provided Provided	MR MR MR MR MR
20	Special Fire Protection Systems for Protection of Special Risks, if Any:	CO ₂ Panel flooding for HT & LT Panel	Provided	MR

The fire protection systems provided in the building were tested/checked and found functional at the time of inspection.

Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety required under the rules the FSC issued vide letter No. for **Block-A** and fire safety required under the rules the FSC issued vide letter No. for **Block-B** F.6/DFS/MS/2022/ NDZ/29 dated F.6/DFS/MS/2022/NDZ/11 dated 16/08/2022, **Block-B** F.6/DFS/MS/2022/ NDZ/29 dated 28/12/2022, **Block-C** F.6/DFS/MS/2022/NDZ/28 dated 28/12/2022 & **Auditorium Building** F.6/DFS/MS/Bnqt./2023/NDZ/College/17 dated 09/06/2023 **renewal under rule 35 of the Delhi Fire Service Rule, 2010** is recommended.


21/01/2026.

Signature of the Inspecting Officer

Name :- Deepak Kumar

Designation :- A.D.O (TP/Shah.)

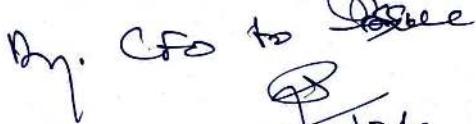
DO (ED)


21/1/26

Dy. CFO (NSI)


21/1/26


Principal Director


21/1/26

Dy. CFO (NSI)


21/1/26

DO (ED) As approved, F.G. letter is put up for
signature please


21/1/26

Dy. CFO (NSI)


21/1/26