

e 204

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**

No. F6/DFS/MS/WZ/2025/Collage/01

Dated: 06/01/2025

FIRE SAFETY CERTIFICATE

Certified that the Block No.9, at Campus, Maharaja Agrasen Technical Education Society, Plot No.1, PSP Area, Sector-22, Rohini, Delhi-110086, comprised of Basement + Stilt + 9 upper floors has already been issued FSC by this department vide letter No. F.6/DFS/MS/WZ/2021/Collage/16 dated 13.10.2021. The premises was re-inspected by the officer concerned of this department on 19.12.2024 in the presence of Mr. Arun Roy and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010, and that the premises fit for occupancy class Group B Educational with effect from 06/01/2025 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 06/01/2025 at New Delhi by


(Atul Garg)
DIRECTOR
Ph; 011-23414000
du

Copy to:

1. Sh. T. R. Garg, (General Secretary), Block No.9, at Campus, Maharaja Agrasen Technical Education Society, Plot No.1, PSP Area, Sector-22, Rohini, Delhi-110086.

Conditions for validity of Fire Safety Certificate;

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form "K" is available on
http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules
/ http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms

21/65

INSPECTION REPORT

1. Name & address of the building	Block No.9, at Campus, Maharaja Agrasen Technical Education Society, Plot No.1, PSP Area, Sector-22, Rohini, Delhi-110086.
2. Type of Occupancy	Educational
3. Type of Case	Renewal (Basement + Stilt + 09 upper floor)
4. Details of Previous NOC	F.6/DFS/MS/WZ/2021/Collage/16 dated 13.10.2021.
5. Fire Safety directives letter No	-NA-
6. Date of inspection	19.12.2024
7. Name of Inspecting Officer	Sh. Ajay Kumar Sharma (ADO Rohini)
8. Name and designation of officers From the building side	Mr. Arun Roy
9. Year of Construction	2011
10. Applicant's letter No.	OD No.7471 dated 07.10.2024 & 18.12.2024


S. No	Minimum Standards on fire prevention and fire safety U/R 33	BBL/NBC	Provided at site	Remarks MR/NMR
1.	Access to building			
	• Road width	12m	Provided	MR
	• Gate width	6m	Provided	MR
	• Width of internal road	6m	Provided	MR
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	02nos.	Provided	MR
	• Basements	02nos.	Provided	MR
	b. Width of staircases			
	• Upper Floor	1.5m	Provided	MR
	• Basements	1.5m	Provided	MR
	c. Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	-NA-	Provided	-NA-
	d. No. of continuous staircases to terrace	02nos.	Provided	MR
	e. Width of Corridor	1.5m	Provided	MR
	f. Door Size	1.5m	Provided	MR
3.	Compartmentation			
	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	Required	Provided	MR
	• Fire Rating of shaft door	-NA-	-NA-	-NA-
	• Water Curtain	-NA-	-NA-	-NA-
	• Fire Dampers	-NA-	-NA-	-NA-
4.	Smoke Management System			
	a) Basements	30 /c per hour	Exhaust fan	MR
	b) Upper floors	12 a/c per hour	Natural ventilated	MR
5.	Fire Extinguishers			
	• Total numbers	36nos.	Provided	MR
	• Types	ABC/CO2	ABC/CO2	MR
	• IS marking	ISI marked	Yes	MR
6.	First-Aid Hose Reels			
	• Total numbers on each floor	01nos.	Provided	MR
	• Length of hose reel hose	30mm	Provided	MR
	• Nozzle diameter	5m	Provided	MR
7.	Automatic fire detection and alarming system			
	a) Type of detectors	-NA-	-NA-	-NA-

	b) Location of Main Panel	-NA-	-NA-	-NA-
	c) Location of Repeater Panel	-NA-	-NA-	-NA-
	d) Alternate source of power	-NA-	-NA-	-NA-
	e) Hooters' Location	-NA-	-NA-	MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			-NA-
	• Basement	Required	Provided	-NA-
	• Ground & Upper Floors	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	MR
11.	Internal Hydrants			MR
	• Size of riser/down-comer	100mm	Provided	MR
	• Number of hydrants per floor	02nos.	Provided	MR
	• Hose Box	02nos.	Provided	MR
12.	Yard Hydrants			MR
	• Total number of hydrants	Required	Provided	MR
	• Hose Box	02nos.	Provided	MR
13.	Pumping Arrangements			MR
	• Ground Level			MR
	➤ Discharge of main Pump	2280lpm	Provided	MR
	➤ Head of Main pump	Required	Provided	MR
	➤ Number of main pumps	01nos.	Provided	MR
	➤ Jockey Pump out put	180lpm	Provided	MR
	➤ Jockey pump head	Required	Provided	MR
	➤ Standby Pump out put	2280lpm	Provided	MR
	➤ Standby Pump Head	Required	Provided	MR
	➤ Auto Starting/Manual Stopping	Required	Provided	MR
	➤ Pump House Access	Required	Provided	MR
	Terrace level			MR
	➤ Discharge of pump	900lpm	Provided	MR
	➤ Head of the pump	Required	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14.	Captive Water Storage for fire fighting			MR
	• Underground tank capacity	200000ltr	Provided	MR
	➤ Draw-off connection	Required	Provided	MR
	➤ Fire service inlet	Required	Provided	MR
	➤ Access to tank	Required	Provided	MR
	• Overhead Tank capacity	25,000ltr	Provided	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			MR
	• Pressurization of Lift Shaft	Required	Provided	MR
	• Pressurization of Lift lobby	-NA-	-NA-	-NA-
	• Communication In lift Car	-NA-	-NA-	-NA-
	• Fireman's Grounding Switch	Required	Provided	MR
	• Lift Signage	Required	Provided	MR
17.	Standby power supply	Required	Provided DG set	MR
18.	Refuge Area.			MR
	➤ Total Area	Required	Provided	MR
	➤ Location	5 th floor	Provided	MR


19.	Fire Control Room	-NA-	-NA-	-NA-
	• Detector System Panel	-NA-	-NA-	-NA-
	• Flow Switch Panel	Required	Provided	MR
	• PA System Panel	Required	Provided	MR
	• Battery backup	Required	Provided	MR
	• Building Floor Plans	-NA-	-NA-	-NA-
20.	Special Fire Protection System for Protection of special Risks, if any:			


Accordingly, the fire protection systems provided in the building were tested/ checked randomly and found in working condition at the time of inspection.


In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F.6/DFS/MS/WZ/2021/Collage/16 dated 13.10.2021 is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.

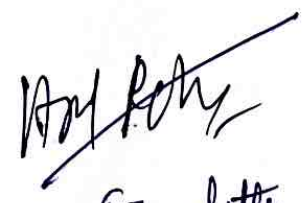

 Signature of the Inspecting Officer
 Name Ajay Kumar Sharma
 Designation: ADO(Rohini)

D.B Mukherjee
 DO (NW)


 26/12/2024
 Dy CPO (WZ)

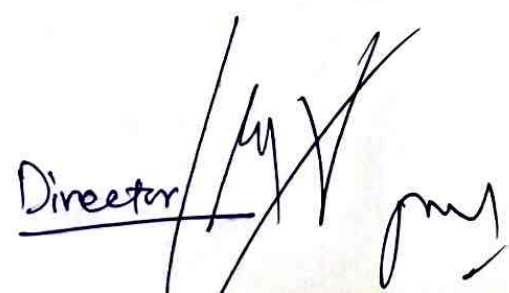

 30/12/2024


 31/12/2024
 Director



FT letter is put up for kind
 Perusal and signature please.


 21/1/25


 Director

31/12/2024
 30/12/2024