

c/25

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS : DELHI FIRE SERVICE : NEW DELHI - 110001

No.F6/DFS/MS/SD/2025/ **EH/42B**

Dated: **12/11/2025**

To,

The Manager,
M/S Haldiram Marketing Pvt. Ltd,
C-9, Malviya Nagar, New Delhi-110017.

Sub: Issuance of FSC (Fire Safety Certificate) in r/o M/S Haldiram Marketing Pvt. Ltd. located at C-9, Malviya Nagar, New Delhi-110017.

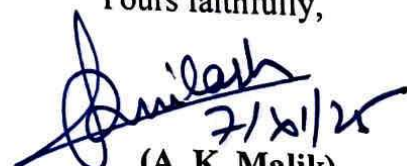
Sir,

This has reference to ID No. 2025101314151 dated 13.10.2025, on the subject cited above, it is to inform you that the site was inspected by the officer concerned of this department on 25/10/2025 in the presence of Sh. Sai Ram (Manager) and the following shortcomings were observed:-

1. Main staircase found reduced to 1.5 m against the requirement of 2 m.
2. Smoke management system found removed in basement.
3. Exit Signage found removed.
4. Underground water tank found empty.
5. Pump not in auto mode provision.

In view of above, the case is rejected and Fire Safety Certificate (FSC) cannot be renewed at this stage. Therefore, you are requested to rectify the above shortcomings and re-submit for further consideration in the matter.

Yours faithfully,


(A. K. Malik)
Dy. Chief Fire Officer
Delhi Fire Service
7/11/25
det

Copy to:-

The Commissioner MCD, Civic Centre, New Delhi.