



### FIRE SAFETY CERTIFICATE

Certified that the G.D. Goenka Public School, Pocket - 8 & 9, Sector - B, Vasant Kunj, New Delhi – 110070 in a building comprised of Basement, Ground plus three upper floors owned / occupied by G.D. Goenka Public School, was earlier issued Fire Safety Certificate vide letter no. F6/DFS/MS/School/2022/SZ/1261 dated 25/11/2022. Now, the school building was re-inspected by the officer concerned of this department on 13/01/2026 in the presence of Mr. Tarun (Administrator) and found that the school has deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of Delhi Fire Service Rules, 2010 and that the school building is fit for occupancy class (Group - B) **“Educational Building”** with effect from 21/01/2026 for a period of **three years** in accordance with Rule 36 unless renewal under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the DFS Rules, 2010 is recommended.

Issued on 21/01/2026 at New Delhi by.

A. K. Malik

Dy. Chief Fire Officer  
Delhi Fire Service

o/c (W)

Copy to:-

1. The Principal, G.D. Goenka Public School, Pocket - 8 & 9, Sector - B, Vasant Kunj, New Delhi - 110070.
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi - 110054.

### Conditions for the validity of Fire Safety Certificate

1. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipment's and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the firefighting equipment's shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc. may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).

**INSPECTION REPORT**

01.	Name & address of the building	G.D. Goenka Public School, Pocket - 8 & 9, Sector - B, Vasant Kunj, New Delhi - 110070.		
02.	Building is comprised of	Basement, Ground plus three upper floors.		
03.	Type of occupancy	Educational Building, Group - B (School)		
04.	Type of case	Renewal Case		
05.	Details of previous FSC	F6/DFS/MS/School/2022/SZ/1261 dated 25/11/2022		
06.	Fire safety directives letter no.	F.6/DFS/MS/BP/95/87 dated 25/01/1995 F.6/MS/DFS/BP/2008/3123 dated 12/11/2008		
07.	Date of inspection	13.01.2026		
08.	Name of the inspecting officers	Yashwant Singh Meena ADO/BCP		
09.	Name of the designation of officer from the building side	Mr. Tarun (Administrator)		
10.	Year of construction	2000 & 2008		
11.	Applicant's letter no.	Outdoor dairy No. 8268 dated 14/11/2025		
S.No	Minimum standard of fire prevention and fire safety U/R 33	Old NOC Requirement	Provided at site	Remarks MR/NMR
01.	<b>Access to Building:</b>			
	A Road width	Required	9 meters	MR
	B Gate width	Required	5 meters	MR
	C Width of internal road	N/A	N/A	N/A
02.	<b>Number, Width, Type and Arrangement of Exits:</b>			
	A Number of staircases			
	a Upper floor	02 nos.	Provided	MR
	C Basement	02 nos.	Provided	MR
	B Width of staircases			
	a Upper floor	1.50 meters	2.10 m each	MR
	C Basement	1.50 meters	1.22 m each	MR <i>1.6/1.22</i>
	C Protection of exits			
	a Fire check door	N/A	N/A	N/A
	b Pressurization	N/A	N/A	N/A
	D No. of continuous staircases to terrace	Required	Provided	MR
	E Width of corridor	N/A	N/A	N/A
	F Door size	N/A	N/A	N/A
03.	<b>Compartmentation:</b>			
	A Fire check door	N/A	N/A	N/A
	B Sealing of electrical shafts	N/A	N/A	N/A
	C Fire rating of shaft door	N/A	N/A	N/A
	D Water curtain	N/A	N/A	N/A
	E Fire dampers	N/A	N/A	N/A
04.	<b>Smoke Management System:</b>			
	A Basement	30ACPH	Provided	MR
	B Upper floor	12ACPH	Provided	MR
05.	<b>Fire Extinguisher:</b>			
	A Total numbers	Required	40 nos.	MR
	B Types	ABC/CO <sub>2</sub>	ABC/CO <sub>2</sub>	MR
	C ISI marking	ISI Marked	ISI Marked	MR

(W)


4125

<b>06. First-Aid-Hose Reel:</b>				
<b>A</b>	Total numbers of each floor	Two 30 m 5mm	Provided	MR
	Length of hose reel hose		Provided	MR
	Nozzle diameter		Provided	MR
<b>07. Automatic Fire Detection and Alarming System:</b>				
<b>A</b>	Type of detectors	N/A	N/A	N/A
	Location of main panel	N/A	N/A	N/A
	Location of repeater panel	N/A	N/A	N/A
	Alternate source of power	N/A	N/A	N/A
	Hooters	N/A	N/A	N/A
<b>08. MOEFA:</b>				
<b>09. Public Address System:</b>				
<b>10. Automatic Sprinkler System:</b>				
<b>A</b>	Basement	Required	Provided	MR
	Upper floor	N/A	N/A	N/A
	Sprinkler above false ceiling	N/A	N/A	N/A
<b>11. Internal Hydrants:</b>				
<b>A</b>	Size of riser/down-comer	Required	100 mm	MR
	Number of hydrants per floor	Required	02 nos.	MR
	Hose box	Required	02 nos.	MR
<b>12. Yard Hydrants:</b>				
<b>A</b>	Total number of hydrants	N/A	N/A	N/A
	Hose box	N/A	N/A	N/A
<b>13. Pumping Arrangements:</b>				
<b>1. Ground level</b>				
<b>A</b>	Discharge of main pump	N/A	1200 LPM	N/A
	Head of main pump	N/A	45 mtr	N/A
	Number of main pumps	N/A	N/A	N/A
	Jockey pump out put	N/A	N/A	N/A
	Jockey pump head	N/A	N/A	N/A
	Standby pump out put	N/A	N/A	N/A
	Standby pump head	N/A	N/A	N/A
	Auto starting /manual stopping	N/A	N/A	N/A
	Pump house access	N/A	N/A	N/A
<b>2. Terrace Level</b>				
<b>A</b>	Discharge of pump	900 LPM	900 LPM	MR
	Head of the pump	40 m	40 m	MR
	Power supply	Required	Provided	MR
	Auto starting of pump	Required	Provided	MR
<b>14. Captive Water Storage for Fire Fighting:</b>				
<b>A</b>	Underground tank capacity	1,00,000 liters	1,00,000 liters	MR
	Draw-off connection	N/A	N/A	N/A
	Fire service inlet	N/A	N/A	N/A
	Access to tank	N/A	N/A	N/A
	Overhead tank capacity	25,000 liters	25,000 liters	MR
<b>15. Exit Signage:</b>				
<b>16. Provision of Lifts:</b>				
<b>A</b>	Pressurization of lift shaft	N/A	N/A	N/A
	Pressurization of lift lobby	N/A	N/A	N/A
	Communication in lift car	N/A	N/A	N/A
	Firemen's grounding switch	N/A	N/A	N/A
	Lift signage	N/A	N/A	N/A

17.	Standby Power Supply:	Required	Provided	MR
18.	Refuge Area:			
A	Total area	N/A	N/A	N/A
B	Location	N/A	N/A	N/A
19.	Fire Control Room:			
A	Detector system panel	N/A	N/A	N/A
B	Flow switch panel	N/A	N/A	N/A
C	PA system panel	N/A	N/A	N/A
D	Battery backup	N/A	N/A	N/A
E	Building floor plans	N/A	N/A	N/A
20.	Special Fire Protection systems for protection of special Risks, if any:	NA	N/A	N/A

The fire protection system provided in the building were checked tested at random and found functional at the time of inspection.


Keeping in view of the deemed compliance of minimum standards on fire prevention and fire safety measures as required under the Rules the Fire Safety Certificate issued vide letter no. F6/DFS/MS/School/2022/SZ/1261 dated 25/11/2022 under Rule 37 of the Delhi Fire Service Rules, 2010 is recommended.




15/11/2026

Signature of the Inspecting Officer  
Name: - Yashwant Singh Meena  
Designation: ADO/BCP


DO/SD




16/11/26




Yashwant Singh Meena




16/11/26




Principal Director

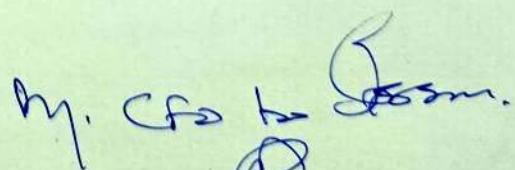


My. Cfo to Dsm.




16/11/26

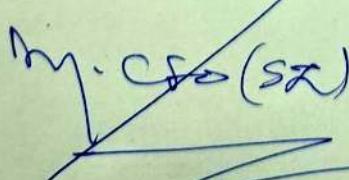


My. Cfo (SZ)



DO/SD

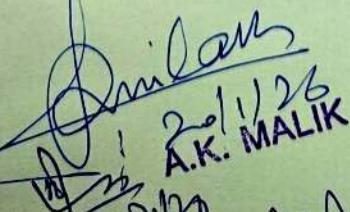

A.K. MALIK  
26/11/26



Mr. A.R.D