



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001



No. F.6/DFS/MS/School/2025/SZ/1298

Dated: 10/11/2025

FIRE SAFETY CERTIFICATE

Certified that buildings of Govt. Co-Ed. Senior Secondary School located at Khaira, New Delhi-110043 (ID: 1822056), comprised of ground plus three upper floors (New Block), owned/occupied by Directorate of Education, Govt. of NCT of Delhi, was issued Fire Safety Certificate by this department vide letter No. F6/DFS/MS/School/2022/SZ/939 dated 01/09/2022. The premise was re-inspected by the officer concerned of this department on 28/10/2025 in the presence of Sh. Jogendra Singh (Vice Principal) and found that said premises have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the school premise/building is fit for occupancy class "Educational Group B" with effect from 10/11/2025 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 10/11/2025 at New Delhi by


(A.K. Malik)
Dy. Chief Fire Officer (SZ)
Delhi Fire Service


Copy to: -

1. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi-110054
2. The Principal/HOS, Govt. Co-Ed. Senior Secondary School, Khaira, New Delhi-110043

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working conditions at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire-fighting system.
4. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
5. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, prior to its expiry.
6. The owner/occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in

N-27

INSPECTION REPORT				
1.	Name & address of the building	Govt. Co-Ed. Senior Secondary School at Khaira, New Delhi-110043 (1822056)		
2.	Type of Occupancy	Educational (Group-B)		
3.	Building Comprised of	Ground + Three upper floors (New Block)		
4.	Type of Case	Renewal		
5.	Details of previous NOC No.	F6/DFS/MS/School/2022/SZ/939 Dt.01/09/2022		
6.	Fire Safety directives Letter No.	NBC Part-IV		
7.	Date of inspection	28/10/2025		
8.	Name of the Inspecting Officer	ADO (JKP)		
9.	Name and designation of Officer from the building side	Sh. Jogendra Singh (Vice Principal)		
10.	Year of Construction	2022 (C/31)		
11.	Applicant's letter No.	G.Co-ed. SSS/Khaira/2025/415 dated 14/10/2025 Received through ODD No. 7163 Dt.16/10/2025		
S. No.	Minimum standards on fire prevention and fire safety U/R 33	Old NOC Requirement	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	6.0 mtr	6.0 mtr	MR
	• Gate width	4.5 mtr	4.5 mtr	MR
	• Width of internal road	-NA-	-NA-	-NA-
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	02 Nos	02 Nos	MR
	• Basements	-NA-	-NA-	-NA-
	b. Width of staircases			
	• Upper floors	1.50 mtr	1.80 mtr each	MR
	• Basements	-NA-	-NA-	-NA-
	c. Protection of exits			
	• Fire check door	-NA-	-NA-	-NA-
	• Pressurization	-NA-	-NA-	-NA-
	d. No of continuous staircase to terrace	02 Nos	02 Nos	MR
	e. Width of Corridor	1.50 mtr	1.80 mtr	MR
	f. Door Size	1.20 mtr	1.20 mtr	MR
3.	Compartmentation			
	• Fire check door	-NA-	-NA-	-NA-
	• Sealing of electrical shafts	-NA-	-NA-	-NA-
	• Fire Rating of shaft door	-NA-	-NA-	-NA-
	• Water Curtain	-NA-	-NA-	-NA-
	• Fire Dampers	-NA-	-NA-	-NA-
4.	Smoke Managements System			
	• Basements	-NA-	-NA-	-NA-
	• Upper floors	Required	Natural ventilation	-NA-
5.	Fire Extinguishers			
	• Total numbers	06 Nos	06 Nos	MR
	• Types	ABC / CO ₂	ABC & CO ₂	MR
	• ISI marking	ISI Marked	Provided	MR
6.	First-Aid Hose Reels			
	• Total numbers on each floor	02 Nos	02 Nos	MR
	• Length of hose reel hose	30m	30m	MR
	• Nozzle diameter	5mm	5mm	MR

87

7.	Automatic fire detection and alarming system			
	• Type of detector	-NA-	-NA-	-NA-
	• Location of Main Panel	-NA-	-NA-	-NA-
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	-NA-	-NA-	-NA-
	• Hooters' Location	-NA-	-NA-	-NA-
8.	MOEFA	-NA-	-NA-	-NA-
9.	Public Address System	-NA-	Provided	-NA-
10.	Automatic Sprinkler System			
	• Basements	-NA-	-NA-	-NA-
	• Upper Floor	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
11.	Internal Hydrants			
	• Size of riser/down- comer	-NA-	-NA-	-NA-
	• Number of hydrants per floor	-NA-	-NA-	-NA-
	• Hose Box	-NA-	-NA-	-NA-
12.	Yard Hydrants			
	• Total number of hydrants	-NA-	-NA-	-NA-
	• Hose Box	-NA-	-NA-	-NA-
13.	Pumping Arrangements			
	• Ground Level			
	➤ Discharge of main pump	-NA-	-NA-	-NA-
	➤ Head of main pump	-NA-	-NA-	-NA-
	➤ Number of main pumps	-NA-	-NA-	-NA-
	➤ Jockey pump out put	-NA-	-NA-	-NA-
	➤ Jockey pump head	-NA-	-NA-	-NA-
	➤ Standby Pump out put	-NA-	-NA-	-NA-
	➤ Standby Pump Head	-NA-	-NA-	-NA-
	➤ Auto Starting/Manual stopping	-NA-	-NA-	-NA-
	➤ Pump House Access	-NA-	-NA-	-NA-
	• Terrace level			
	➤ Discharge of pump	450 LPM	450 LPM	MR
	➤ Head of the pump	40m	40m	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14.	Captive water storage for firefighting			
	• Underground tank capacity	-NA-	-NA-	-NA-
	➤ Draw of connection	-NA-	-NA-	-NA-
	➤ Fire service inlet	-NA-	-NA-	-NA-
	➤ Access to tank	-NA-	-NA-	-NA-
	• Overhead Tank capacity	10,000 Ltr	Provided	MR
15.	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	-NA-	-NA-	-NA-
	➤ Pressurization of lift lobby	-NA-	-NA-	-NA-
	➤ Communication in lift Car	-NA-	-NA-	-NA-
	➤ Fireman's Grounding Switch	-NA-	-NA-	-NA-
	➤ Lift Signage	-NA-	-NA-	-NA-
17.	Standby Power Supply	Required	Provided	MR
18.	Refuge Area			
	➤ Total area	-NA-	-NA-	-NA-
	➤ Location	-NA-	-NA-	-NA-

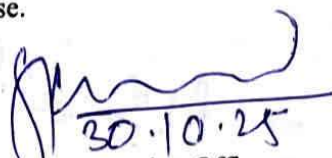
N-29

19.	Fire Control Room			
	➤ Detector system panel	-NA-	-NA-	-NA-
	➤ Flow Switch Panel	-NA-	-NA-	-NA-
	➤ PA System Panel	-NA-	-NA-	-NA-
	➤ Battery backup	-NA-	-NA-	-NA-
	➤ Building Floor Plans	-NA-	-NA-	-NA-
20.	Special Fire Protection Systems for Protection of Special Risks, if any;	-NA-	-NA-	-NA-

The fire protection systems provided in the building were checked, tested at random and found functional at the time of inspection. The shortcomings earlier issued vide letter No. F6/DFS/MS/School/2025/SZ/643 dated 14/08/2025 found complied.

Keeping in view of the deemed compliance of the minimum standards on fire prevention and fire safety required under the rules, the fire safety certificate issued vide letter No. F6/DFS/MS/School/2022/SZ/939 dated 01/09/2022, **renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended.**

Accordingly, DFA is put up for approval & signature please.

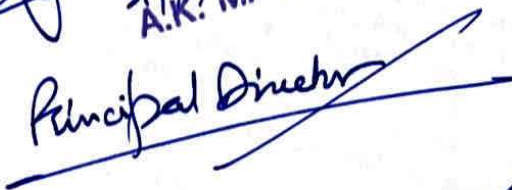

30.10.25
Signature of the Inspecting Officer
Name: Santosh Kumar
Designation: ADO (JKP)

DO (SW) 
25/10/25

RAJINDER ATWAL

Dy. CFS (SZ)


31/10/25
A.K. MALIK


Principal Director

Dy. CFS to Secy.

01/11/25

Dy. CFS (SZ)



3/11/25
A.K. MALIK

DO (SW)

4/11

ADO (JKP) 

P.T.O