



No. F6/DFS/MS/SCHOOL/SZ/2025/1346

Dated: 26/11/2025

FIRE SAFETY CERTIFICATE

Certified that the Govt. Girls Sr. Sec. School No. 3 (Morning Shift) / Govt. Boy Sr. Sec. School No. 2 (Evening Shift) located at Badarpur, New Delhi – 110044, School - ID 1925248 (Morning Shift) & 1925051 (Evening Shift), Building ID No. 19251636, was granted Fire Safety Certificate by this department vide letter No. F6/DFS/MS/School/SZ/2023/322 dated 15/05/2023. The school building was re-inspected by Assistant Divisional Officer (M. Road) from this department on 13/11/2025 in presence of Mrs. Anju Pawar (Principal) and found that the building is comprised of five blocks A, B, C, D & E (A block – Ground + 2 upper floors, B block – Ground + 2 upper floors, C block – Ground + 1 upper floors, D block – Ground + 2 upper floors & E block Ground + 3 upper floors & A, B, C & D blocks are interconnected at all floors level & 2 nos. of MP hall (separate) at ground floor separately) and has deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of Delhi Fire Service Rules, 2010. Accordingly, the premises/ building comprised five blocks A, B, C, D & E (A block – Ground + 2 upper floors, B block – Ground + 2 upper floors, C block – Ground + 1 upper floors, D block – Ground + 2 upper floors & E block Ground + 3 upper floors) is fit for occupancy of “**Educational Building**” with effect from 26/11/2025 for a period of three years in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance under Rules 28 of Delhi Fire Service Rule, 2010 printed below.

Issued on 26/11/2025 at New Delhi by.


(A.K. Malik)
Dy. Chief Fire Officer
Delhi Fire Service
o/c

Copy to: -

1. The Director of Education, Govt of NCT of Delhi, Old Secretariat, Delhi – 110054.
2. The Assistant Engineer (E) Edu. Maint.Sub-div-M1, PWD, Hauz Khas, New Delhi – 110016.
3. The Principal, Govt. Girls Sr. Sec. School No. 3 (Morning Shift) / Govt. Boy Sr. Sec. School No. 2 (Evening Shift) located at Badarpur, New Delhi – 110044.

Conditions for the validity of Fire Safety Certificate

1. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipment's and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the firefighting equipment's shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc. may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1	Name & address of the building	Govt. Girls Sr. Sec. School No. 3 (Morning Shift)/ Govt. Boy Sr. Sec. School No. 2 (Evening Shift), located at Badarpur, New Delhi - 110044. School ID No. 1925248 (Morning Shift) School ID No. 1925051 (Evening Shift) Building ID No. 19251636		
2	Building is comprised of	Comprised of five blocks namely: A, B, C, D & E A block - Ground + 2 Upper floors B block - Ground + 2 Upper floors C block - Ground + 1 Upper floors D block - Ground + 2 Upper floors E block - Ground + 3 Upper floors A, B, C & D blocks are interconnected at all floors level & 02 nos. of MP hall (Separate) at ground floor (one with stage and another without stage)		
3	Type of occupancy	Educational Building (Group -B)		
4	Type of case	Renewal Case		
5	Details of previous FSC	F6/DFS/MS/School/SZ/2023/322 dated 15/05/2023		
6	Fire safety directives letter no.	Nil		
7	Date of inspection	14/11/2025		
8	Name of the inspecting officers	Yashwant Singh Meena, ADO/Mathura Road		
9	Name of the designation of officer from the building side	Mrs. Anju Pawar (Principal)		
10	Year of construction	2014 - 16		
11	Applicant's letter no.	Outdoor Diary No. Nil dated 09/10/2025		
S. No	Minimum standard of fire prevention and fire safety U/R 33	NBC/UBBL Requirement	Provided at site	Remarks MR/NMR
1	Access to Building:			
	A Road width	6.0 meters.	6.0 meters.	MR
	B Gate width	N/A	N/A	N/A
	C Width of internal road	N/A	N/A	N/A
2	Number, Width, Type and Arrangement of Exits:			
	A Number of staircases			
	a Upper floor	A block - 02 nos. B block - 01 no. C block - 01 no. D block - 02 nos. E block - 04 nos.	A block - 02 nos. B block - 01 no. C block - 01 no. D block - 02 nos. E block - 04 nos.	MR (All blocks are interconnected at all floor level except E blocks)
	b Basement	N/A	N/A	N/A
	B Width of staircases			
	a Upper floor	1.5 meters block	1.6 meters block	MR
	b Basement	N/A	N/A	N/A
	C Protection of exits			
	a Fire check door	N/A	N/A	N/A
	b Pressurization	N/A	N/A	N/A
	D No. of continuous staircases to terrace	Required	Provided	MR
	E Width of corridor	1.50 meter	Provided	MR
	F Door size	Required for MP Hall	1 MP hall - 02 nos. Exit (2.0 & 1.80 meter) 2 nd MP hall = 5 nos. Exit (1.52 m, 1.25 m, 1.25 m & 1.25 m)	MR
3	Compartmentation:			
	A Fire check door	NA	NA	NA
	B Sealing of electrical shafts	N/A	N/A	N/A
	C Fire rating of shaft door	N/A	N/A	N/A
	D Water curtain	N/A	N/A	N/A
	E Fire dampers	N/A	N/A	N/A
4	Smoke Management System:			
	A Basement	N/A	N/A	N/A
	B Upper floor	N/A	N/A	N/A

5. Fire Extinguisher:				
A	Total numbers	50 No's.	70 No's.	MR
B	Types	CO ₂ & ABC	CO ₂ & ABC	MR
C	ISI marking	ISI mark	Provided	MR
6 First-Aid-Hose Reel:				
A	Total numbers of each floor	A block – 01 no. B block – 01 no. D block – 03 nos. E block – 04 nos.	A block – 01 no. B block – 01 no. C block – 01 no. D block – 03 nos. E block – 04 nos.	MR
B	Length of hose reel hose	30 m	Provided	MR
C	Nozzle diameter	05 mm	Provided	MR
7 Automatic Fire Detection and Alarming System:				
A	Type of detectors	N/A	N/A	N/A
B	Location of main panel	N/A	N/A	N/A
C	Location of repeater panel	N/A	N/A	N/A
D	Alternate source of power	N/A	N/A	N/A
E	Hooters	N/A	N/A	N/A
8	MOEFA:	N/A	N/A	N/A
9	Public Address System:	N/A	Provided	N/A
10 Automatic Sprinkler System:				
A	Basement	N/A	N/A	N/A
B	Upper floor	N/A	N/A	N/A
C	Sprinkler above false ceiling	N/A	N/A	N/A
11 Internal Hydrants:				
A	Size of riser/down-comer	N/A	N/A	N/A
B	Number of hydrants per floor	N/A	N/A	N/A
C	Hose box	N/A	N/A	N/A
12 Yard Hydrants:				
A	Total number of hydrants	N/A	N/A	N/A
B	Hose box	N/A	N/A	N/A
13 Pumping Arrangements:				
1	Ground level			
A	Discharge of main pump	N/A	N/A	N/A
B	Head of main pump	N/A	N/A	N/A
C	Number of main pumps	N/A	N/A	N/A
D	Jockey pump out put	N/A	N/A	N/A
E	Jockey pump head	N/A	N/A	N/A
F	Standby pump out put	N/A	N/A	N/A
G	Standby pump head	N/A	N/A	N/A
H	Auto starting /manual stopping	N/A	N/A	N/A
I	Pump house access	N/A	N/A	N/A
2	Terrace Level (Common fire system provided by managements for A, B & D blocks)			
A	Discharge of pump	02 nos. of 450 LPM (common fire pump for A, B, & D block) E block – 450 LPM	02 nos. of 450 LPM (common fire pump for A, B, & D block) E block – 04 nos. of 450 LPM	MR
B	Head of the pump	40 m each	40 m each	MR
C	Power supply	Required	Provided	MR
D	Auto starting of pump	Required	Provided	MR
14 Captive Water Storage for Fire Fighting:				
A	Underground tank capacity	N/A	N/A	N/A
B	Draw-off connection	N/A	N/A	N/A
C	Fire service inlet	N/A	N/A	N/A
D	Access to tank	N/A	N/A	N/A
E	Overhead tank capacity	A, B, & D - 10,000 liters E – block 10,000 liters	Provided	MR

15	Exit Signage:	Required	Provided	MR
16	Provision of Lifts:			
	A Pressurization of lift shaft	N/A	N/A	N/A
	B Pressurization of lift lobby	N/A	N/A	N/A
	C Communication in lift car	N/A	N/A	N/A
	D Firemen's grounding switch	N/A	N/A	N/A
	E Lift signage	N/A	N/A	N/A
17	Standby Power Supply:	N/A	N/A	N/A
18	Refuge Area:			
	A Total area	N/A	N/A	N/A
	B Location	N/A	N/A	N/A
19	Fire Control Room:			
	A Detector system panel	N/A	N/A	N/A
	B Flow switch panel	N/A	N/A	N/A
	C PA system panel	N/A	N/A	N/A
	D Battery backup	N/A	N/A	N/A
	E Building floor plans	N/A	N/A	N/A
20	Special Fire Protection systems for protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested, checked at random and found functional at the time of inspections.

Keeping in view of the deemed compliance of minimum standards of fire prevention and fire safety measures as required under the rules the FSC issued vide letter F6/DFS/MS/School/SZ/2023/322 dated 15/05/2023, renewal under Rule 37 (6) of the Delhi Fire Service rules 2010, is recommended.

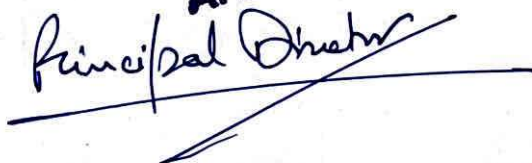
Signature of the Inspecting Officer
Name Yashwant Singh Meena
Designation ADO/Mathura Road

D.O/SO


18/11/25
Ravinder Singh


18/11/25
A.K. MALIK

Principal Officer

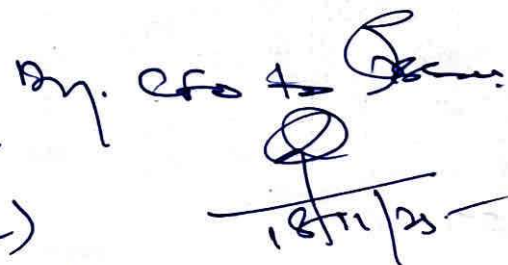

20/11/25
A.K. MALIK


20/11/25
A.K. MALIK


20/11/25
A.K. MALIK


20/11/25
A.K. MALIK


20/11/25
A.K. MALIK


20/11/25
A.K. MALIK