

No. F6/DFS/MS/School/SZ/2025/ 1279

Dated: 31/10/2025

FIRE SAFETY CERTIFICATE

Certified that the Govt. Sarvodaya Co-ed Senior Secondary School, Sector-06, R.K. Puram, New Delhi (School ID-1719070), building comprised of 04 Blocks, each Ground plus one upper floor, owned / occupied by Directorate of Education, Govt. of NCT of Delhi, was earlier issued Fire Safety Certificate by this department vide letter No. F6/DFS/MS/School/2022/SZ/1126 dated 10/10/2022. Now, the said premises was re-inspected by ADO/BCP of this department on 17/10/2025 in presence of Sh. Ram Pravesh Mishra (Principal) and found that the said school building have deemed complied with the fire prevention and fire safety requirements in accordance with Directorate of Education Circular No.F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01/03/2011 issued by the Director of Education, Govt. of NCT of Delhi and that the school building is fit for occupancy class "Educational Building" (Group - B) with effect from 31/10/2025 for a period of three years in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of Delhi Fire Service Rules 2010.

Issued on 31/10/2025 at New Delhi by.


(A.K. Malik)
Dy. Chief Fire Officer
Delhi Fire Service
o/c @

Copy to: -

1. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi-110054.
2. The Principal, Govt. Sarvodaya Co-ed Seniro Secondary School, Sector-06, R.K. Puram, New Delhi (School ID-1719070).

Conditions for the validity of Fire Safety Certificate

1. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipment's and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the firefighting equipment's shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc. may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in

r/18

INSPECTION REPORT

01.	Name & address of the building	Govt. Sarvodaya Co-ed Senior Secondary School, Sector-06, R.K. Puram, New Delhi (School ID-1719070)		
02.	Building is comprised of	04 Blocks, each Ground plus one upper floor		
03.	Type of occupancy	Educational Building (Group-B)		
04.	Type of case	Renewal		
05.	Details of previous FSC	F6/DFS/MS/School/2022/SZ/1126 dated 10/10/2022		
06.	Fire safety directives letter no.	F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01/03/2011		
07.	Date of inspection	17.10.2025.		
08.	Name of the inspecting officers	Yashwant Singh Meena, ADO (BCP)		
09.	Name of the designation of officer from the building side	Mr. Ram Pravesh Mishra (Principal)		
10.	Year of construction	1967, 2012 & 2015		
11.	Applicant's letter no.	Outdoor dairy no. 6288 dated 22/09/2025		
S.No	Minimum standard of fire prevention and fire safety U/R 33	Old NOC Requirement	Provided at site	Remarks MR/NMR
01.	Access to Building:			
	A Road width	Accessible	6.0 mtrs.	MR
	B Gate width	N/A	4.5 mtrs	N/A
	C Width of internal road	N/A	N/A	N/A
02.	Number, Width, Type and Arrangement of Exits:			
	A Number of staircases			MR
	a Upper floor	07 nos.	08 nos.	N/A
	C Basement	N/A	N/A	N/A
	B Width of staircases			MR
	a Upper floor	1.50 m / 0.75 m	Block 01 :- 1.79, 1.30 m Block 02 :- 1.50m, 1.50m & 1.44m Block 03:- 2X 1.50 m Block 04:- 1.67 m	
	C Basement	N/A	N/A	N/A
	C Protection of exits			
	a Fire check door	N/A	N/A	N/A
	b Pressurization	N/A	N/A	N/A
	D No. of continuous staircases to terrace	02 nos.	Provided	MR
	E Width of corridor	N/A	N/A	N/A
	F Door size	1.0 mtr.	Provided	MR
03.	Compartmentation:			
	A Fire check door	N/A	N/A	N/A
	B Sealing of electrical shafts	N/A	N/A	N/A
	C Fire rating of shaft door	N/A	N/A	N/A
	D Water curtain	N/A	N/A	N/A
	E Fire dampers	N/A	N/A	N/A
04.	Smoke Management System:			
	A Basement	N/A	N/A	N/A
	B Upper floor	N/A	N/A	N/A
05.	Fire Extinguisher:			
	A Total numbers	36 nos.	40 nos.	MR
	B Types	ABC/CO ₂	ABC/CO ₂	MR
	C ISI marking	ISI Marked	ISI Marked	MR


06. First-Aid-Hose Reel:				
	A	Total numbers of each floor	N/A	N/A
	B	Length of hose reel hose	N/A	N/A
	C	Nozzle diameter	N/A	N/A
07. Automatic Fire Detection and Alarming System:				
	A	Type of detectors	N/A	N/A
	B	Location of main panel	N/A	N/A
	C	Location of repeater panel	N/A	N/A
	D	Alternate source of power	N/A	N/A
	E	Hooters	N/A	N/A
08. MOEFA:			N/A	N/A
09. Public Address System:			N/A	N/A
10. Automatic Sprinkler System:				
	A	Basement	N/A	N/A
	B	Upper floor	N/A	N/A
	C	Sprinkler above false ceiling	N/A	N/A
11. Internal Hydrants:				
	A	Size of riser/down-comer	N/A	N/A
	B	Number of hydrants per floor	N/A	N/A
	C	Hose box	N/A	N/A
12. Yard Hydrants:				
	A	Total number of hydrants	N/A	N/A
	B	Hose box	N/A	N/A
13. Pumping Arrangements:				
1 Ground level				
	A	Discharge of main pump	N/A	N/A
	B	Head of main pump	N/A	N/A
	C	Number of main pumps	N/A	N/A
	D	Jockey pump out put	N/A	N/A
	E	Jockey pump head	N/A	N/A
	F	Standby pump out put	N/A	N/A
	G	Standby pump head	N/A	N/A
	H	Auto starting /manual stopping	N/A	N/A
	I	Pump house access	N/A	N/A
2 Terrace Level				
	A	Discharge of pump	N/A	N/A
	B	Head of the pump	N/A	N/A
	C	Power supply	N/A	N/A
	D	Auto starting of pump	N/A	N/A
14. Captive Water Storage for Fire Fighting:				
	A	Underground tank capacity	N/A	N/A
	B	Draw-off connection	N/A	N/A
	C	Fire service inlet	N/A	N/A
	D	Access to tank	N/A	N/A
	E	Overhead tank capacity	N/A	N/A
15. Exit Signage:			Required	Provided
				MR

✓/20

16. Provision of Lifts:				
A	Pressurization of lift shaft	N/A	N/A	N/A
B	Pressurization of lift lobby	N/A	N/A	N/A
C	Communication in lift car	N/A	N/A	N/A
D	Firemen's grounding switch	N/A	N/A	N/A
E	Lift signage	N/A	N/A	N/A
17. Standby Power Supply:		NA	N/A	N/A
18. Refuge Area:				
A	Total area	N/A	N/A	N/A
B	Location	N/A	N/A	N/A
19. Fire Control Room:				
A	Detector system panel	N/A	N/A	N/A
B	Flow switch panel	N/A	N/A	N/A
C	PA system panel	N/A	N/A	N/A
D	Battery backup	N/A	N/A	N/A
E	Building floor plans	N/A	N/A	N/A
20. Special Fire Protection systems for protection of special Risks, if any:		NA	N/A	N/A

The fire protection system was randomly checked and tested and was found functional at the time of inspection.

Keeping in view of the deemed compliance of minimum standards on fire prevention and fire safety measures as required under the rules, the Fire Safety Certificate issued vide letter no. F6/DFS/MS/School/2022/SZ/1126 dated 10/10/2022, renewal under rule 37 of the Delhi Fire Service rules, 2010 is **recommended**.


 22/10/2025
 Signature of the Inspecting Officer


Name: - Yashwant Singh Meena

Designation: - ADO/BCP

DO/SD


22/10/25

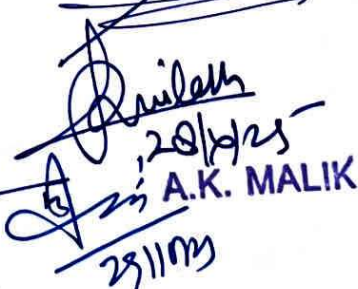



24/10/25
A.K. MALIK
Principal Director

By. CFO to 

By. CFO (S&A)


24/10/25


20/10/25
A.K. MALIK
23/11/25

DO/BCP

P.T.O