



No. F6/DFS/MS/School/SZ/2025/ 1420

Dated: 31 /12/2025

### FIRE SAFETY CERTIFICATE

Certified that the Govt. Co-Ed Sr. Secondary School, New SPS (Semi Pucca Structure) located at Lajpat Nagar-1, New Delhi – 110024, School ID-1925335 (General Shift) & Building ID-19251215, comprised of **ground plus three upper floors & Multipurpose (MP) Hall**, was earlier granted Fire Safety Certificate by this department vide letter No. F6/DFS/MS/School/SZ/2022/1133 dated 11/10/2022. Now the school building was re-inspected by Assistant Divisional Officer (M. Road) form this department on 15/12/2025 in presence of Mrs. Shoba Singh (Principal) and found that the building has deemed complied with the Fire Prevention and Fire Safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010. Accordingly, the premises/building (**Ground plus three upper floors & Multipurpose (MP) Hall**) is fit for occupancy **Class B “Educational Building”** with effect from 31/12/2025 for a period of **three years** in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the DFS rule 2010.

Issued on 31/12/2025 at New Delhi by.

(A.K. Malik)  
Dy. Chief Fire Officer  
Delhi Fire Service  
012

**Copy to: -**

1. The Director of Education, GNCT of Delhi, Old Secretariat, Delhi - 110054.
2. The Principal, Govt. Co-Ed Sr. Secondary School, New SPS (Semi Pucca Structure) located at Lajpat Nagar-1, New Delhi – 110024, School ID-1925335 (General Shift) & Building ID-19251215.

### Conditions for the validity of Fire Safety Certificate

1. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipment's and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the firefighting equipment's shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc. may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).

**INSPECTION REPORT**


1	Name & address of the building	Govt. Co-Ed Sr. Secondary School located at Lajpat Nagar-1, New Delhi - 110024. School ID-1925335 (General Shift) Building ID- 19251215		
2	Building is comprised of	Ground +3 upper floors & Multipurpose(MP) Hall at ground floor		
3	Type of occupancy	Educational Building (Group-B)		
4	Type of case	Renewal Case		
5	Details of previous FSC	F6/DFS/MS/School/SZ/2022/1133 dated 11/10/2022		
6	Fire safety directives letter no.	NBC PART -IV & UBBL 2016		
7	Date of inspection	15/12/2025		
8	Name of the inspecting officers	Yashwant Singh Meena ADO/Mathura Road		
9	Name of the designation of officer from the building side	Mrs. Shoba Singh (Principal)		
10	Year of construction	2018-19		
11	Applicant's letter no.	Outdoor Dairy No. 8699 dated 24/11/2025		
S.No	Minimum standard of fire prevention and fire safety U/R 33	NBC Part-IV Requirement	Provided at site	Remarks MR/NMR
1	<b>Access to Building:</b>			
	A Road width	06 meters.	06 meters	MR
	B Gate width	N/A	N/A	N/A
	C Width of internal road	N/A	N/A	N/A
2	<b>Number, Width, Type and Arrangement of Exits:</b>			
	<b>A Number of staircases</b>			
	a Upper floor	03 nos.	03 nos.	MR
	b Basement	N/A	N/A	N/A
	<b>B Width of staircases</b>			
	a Upper floor	1.5 meters each	1.70 meters. each	MR
	b Basement	N/A	N/	N/A
	<b>C Protection of exits</b>			
	a Fire check door	N/A	N/A	N/A
	b Pressurization	N/A	N/A	N/A
	<b>D No. of continuous staircases to terrace</b>	03 no.	03 no.	MR
	<b>E Width of corridor</b>	1.50 meters.	1.60 meters	MR
	<b>F Door size &amp; No. of Doors</b>	1.0 meters (for class room) 2 nos. x 2.0 meters (for MP hall)	1.0 meters (for class room) MP Hall – 2 meters, 2 meters, 0.82 meters & 0.82 meters	MR
3	<b>Compartmentation:</b>			
	<b>A Fire check door</b>	NA	NA	NA
	<b>B Sealing of electrical shafts</b>	N/A	N/A	N/A
	<b>C Fire rating of shaft door</b>	N/A	N/A	N/A
	<b>D Water curtain</b>	N/A	N/A	N/A
	<b>E Fire dampers</b>	N/A	N/A	N/A
4	<b>Smoke Management System:</b>			
	<b>A Basement</b>	N/A	N/A	N/A
	<b>B Upper floor</b>	N/A	N/A	N/A

<b>5.</b>	<b>Fire Extinguisher:</b>				
	<b>A</b>	Total numbers	30 nos.	90 nos.	MR
	<b>B</b>	Types	CO <sub>2</sub> & ABC	CO <sub>2</sub> & ABC	MR
	<b>C</b>	ISI marking	Required	Provided	MR
<b>6</b>	<b>First-Aid-Hose Reel:</b>				
	<b>A</b>	Total numbers of each floor	3 nos.	3 nos.	MR
	<b>B</b>	Length of hose reel hose	30 meters	30 meters	MR
	<b>C</b>	Nozzle diameter	5 mm	5 mm	MR
<b>7</b>	<b>Automatic Fire Detection and Alarming System:</b>				
	<b>A</b>	Type of detectors	N/A	N/A	N/A
	<b>B</b>	Location of main panel	N/A	N/A	N/A
	<b>C</b>	Location of repeater panel	N/A	N/A	N/A
	<b>D</b>	Alternate source of power	N/A	N/A	N/A
	<b>E</b>	Hooters	N/A	N/A	N/A
<b>8</b>	<b>MOEFA:</b>				
<b>9</b>	<b>Public Address System:</b>				
<b>10</b>	<b>Automatic Sprinkler System:</b>				
	<b>A</b>	Basement	N/A	N/A	N/A
	<b>B</b>	Upper floor	N/A	N/A	N/A
	<b>C</b>	Sprinkler above false ceiling	N/A	N/A	N/A
<b>11</b>	<b>Internal Hydrants:</b>				
	<b>A</b>	Size of riser/down-comer	N/A	N/A	N/A
	<b>B</b>	Number of hydrants per floor	N/A	N/A	N/A
	<b>C</b>	Hose box	N/A	N/A	N/A
<b>12</b>	<b>Yard Hydrants:</b>				
	<b>A</b>	Total number of hydrants	N/A	N/A	N/A
	<b>B</b>	Hose box	N/A	N/A	N/A
<b>13</b>	<b>Pumping Arrangements:</b>				
<b>1</b>	<b>Ground level</b>				
	<b>A</b>	Discharge of main pump	N/A	N/A	N/A
	<b>B</b>	Head of main pump	N/A	N/A	N/A
	<b>C</b>	Number of main pumps	N/A	N/A	N/A
	<b>D</b>	Jockey pump out put	N/A	N/A	N/A
	<b>E</b>	Jockey pump head	N/A	N/A	N/A
	<b>F</b>	Standby pump out put	N/A	N/A	N/A
	<b>G</b>	Standby pump head	N/A	N/A	N/A
	<b>H</b>	Auto starting /manual stopping	N/A	N/A	N/A
	<b>I</b>	Pump house access	N/A	N/A	N/A
<b>2</b>	<b>Terrace Level</b>				
	<b>A</b>	Discharge of pump	450 LPM	2 nos. of 450 LPM	MR
	<b>B</b>	Head of the pump	40 m	40 m	MR
	<b>C</b>	Power supply	Required	Provided	MR
	<b>D</b>	Auto starting of pump	Required	Provided	MR
<b>14</b>	<b>Captive Water Storage for Fire Fighting:</b>				
	<b>A</b>	Underground tank capacity	N/A	N/A	N/A
	<b>B</b>	Draw-off connection	N/A	N/A	N/A
	<b>C</b>	Fire service inlet	N/A	N/A	N/A
	<b>D</b>	Access to tank	N/A	N/A	N/A
	<b>E</b>	Overhead tank capacity	10,000 liters	10,000 liters	MR
<b>15</b>	<b>Exit Signage:</b>				
		Required	Provided	MR	
<b>16</b>	<b>Provision of Lifts:</b>				
	<b>A</b>	Pressurization of lift shaft	N/A	N/A	N/A
	<b>B</b>	Pressurization of lift lobby	N/A	N/A	N/A
	<b>C</b>	Communication in lift car	N/A	N/A	N/A
	<b>D</b>	Firemen's grounding switch	N/A	N/A	N/A
	<b>E</b>	Lift signage	N/A	N/A	N/A
<b>17</b>	<b>Standby Power Supply:</b>				
<b>18</b>	<b>Refuge Area:</b>				

	A	Total area	11/20	N/A	N/A	N/A
	B	Location		N/A	N/A	N/A
19	<b>Fire Control Room:</b>					
	A	Detector system panel		N/A	N/A	N/A
	B	Flow switch panel		N/A	N/A	N/A
	C	PA system panel		N/A	N/A	N/A
	D	Battery backup		N/A	N/A	N/A
	E	Building floor plans		N/A	N/A	N/A
20	<b>Special Fire Protection systems for protection of special Risks, if any:</b>			N/A	N/A	N/A

The fire protection systems provided in the building were tested, checked at random and found functional at the time of inspections.

Keeping in view of the substantial compliance of the minimum standards of fire prevention and fire safety required under the rules the FSC issued vide letter F6/DFS/MS/School/SZ/2022/1133 dated 11/10/2022, renewal under the Rule 37 of the Delhi Fire Service Rules 2010 is recommended.

  
15/12/2025  
Signature of the Inspecting Officer  
Name Yashwant Singh Meena  
Designation ADO/Mathura Road


DO/SD

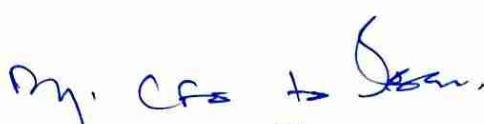
  
22/12/25

Ravinder Singh

  
23/12/25

  
23/12/25  
A.K. MALIK

  
Principal Director


  
Mr. CFO to Dean.

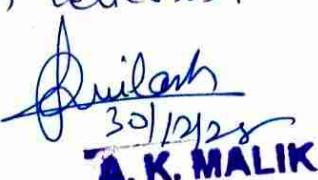
  
My. CFO (SZ)

  
23/12/25

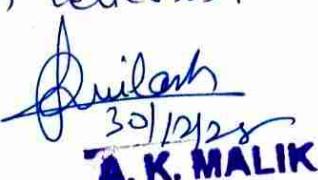
  
24/12/25  
A.K. MALIK

  
DO (SD)

  
22/12/25

  
A.K. Malik  
Sir. F.T letter is putup for sign. Please

  
CFO (SZ)

  
30/12/25  
A.K. MALIK

  
29/12/2025