

d/sr

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No. F.6/DFS/MS/GH/2026/SZ/ 358

Dated: 15/04/2026

FIRE SAFETY CERTIFICATE

Certified that the building of M/s Haldi Foods located at 14/48, Ground & Mezzanine Floor, Shopping Centre, Malcha Marg, New Delhi - 110021, comprises of Basement + Ground + Mezzanine + 01 upper floor. Restaurant is running at ground and mezzanine floor only, have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officer concerned of this department on 08/04/2026 in the presence of Mr. Rakesh (Manager) and that the said building/premises is fit for occupancy class "Assembly, Group D (Restaurant), (Ground + Mezzanine) with effect from 15/04/2026 for a period of **three years** in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 15/04/2026 at New Delhi by


131426
(A. K. Malik)
Chief Fire Officer
Delhi Fire Service

Copy to: -

1. The Commissioner, Municipal Corporation of Delhi, Dr. SPM Civic Center, Minto Road, New Delhi-110002. (w.r.t. online application No. 2026032503577 dated 27/03/2026)
2. The Manager, M/s Haldi Foods located at 14/48, Ground & Mezzanine Floor, Shopping Centre, Malcha Marg, New Delhi - 110021.

Conditions for the validity of Fire Safety Certificate:

1. This FSC is valid for restaurant area's floor only.
2. All the means of escape/entry/exit shall be kept free from any obstruction.
3. All the fire safety arrangement provided therein shall be maintained in good working conditions at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
4. All the staff members must know the correct method of operation of firefighting system.
5. Any deviation with regard to construction, occupancy, electric installation etc., may be got verified from concerned authorities. The use of basement shall be as per BBL concerned.
6. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
7. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, prior to its expiry.
8. The owner/occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on www.dfs.delhigovt.nic.in.

N/A

INSPECTION REPORT

1.	Name & address of the building	M/s Haldi Foods located at 14/48, Ground & Mezzanine Floor, Shopping Centre, Malcha Marg, New Delhi - 110021		
2.	Building Comprised of	Basement + Ground + Mezzanine + 01 upper floor (Restaurant is running at ground & Mezzanine floor only)		
3.	Type of occupancy	Group-D, (Assembly Building)		
4.	Type of case	Renewal		
5.	Details of previous FSC No.	F.6/DFS/MS/EH/2023/SZ/72 dated 28/02/2023		
6.	Fire safety directives No.-	F.6/DFS/MS/EH/2005/718 dated 04/04/2005		
7.	Date of inspection: -	31/03/2026		
8.	Name of the inspecting officer: -	Sh. Kaushal Kishore, ADO(SJ)		
9.	Name & designation of officer from the building side: -	Sh. Rakesh, Manager		
10.	Year of construction: -	2009		
11.	Applicant's letter No: -	Online application ID - 2026032503577 dated 27/03/2026		
S. No.	Minimum Standards on fire Prevention and fire safety U/R 33	Requirement as per the old NOC	Provided at site	Remarks MR/NMR
1.	Access to Building			
	• Road width	Approachable	09 mtrs. (Approx)	MR
	• Gate width	N/A	N/A	N/A
	• Width of internal road	N/A	N/A	N/A
2.	Number, Width Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper floors	02 Nos.	Provided	MR
	• Basements	02 Nos.	Provided	MR
	b. Width of staircase			
	• Upper floors	Required	1.0 mtrs & 0.80m	MR (old Case)
	• Basements	Required	.90 m each	MR (old Case)
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No. of continuous staircase to terrace	Required	Provided	MR
	e. Width of corridor	NA	NA	NA
	f. Door size	02 m	Provided	MR
3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire rating of shaft door	NA	NA	NA
	• Water curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4.	Smoke Management System			
	• Basements	NA	NA	NA
	• Upper floors/Restt. area	Required	Exhaust fan provided	MR
5.	Fire Extinguishers			
	• Total numbers	10 nos.	10 nos.	MR
	• Types	ABC & CO ₂	ABC & CO ₂	MR
	• ISI marking	ISI Marked	Provided	MR

M/s Haldi Foods located at 14/48, G + Mezzanine Floor, Shopping Centre, Malcha Marg, New Delhi -21

2/15

6.	First-Aid Hose Reel			
	• Total number of each floor	1 no.	1 no.	MR
	• Length of hose reel hose	30 mtr.	30 mtr.	MR
	• Nozzle diameter	5 mm	5 mm	MR
7.	Automatic Fire Detection & Alarming System.			
	• Type of detectors	NA	NA	NA
	• Location of main panel	NA	NA	NA
	• Location of repeater panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooter's Location	NA	NA	NA
8.	MOEFA	Required	Provided	MR
9.	Public Address System	NA	NA	NA
10.	Automatic Sprinkler System			
	• Basement	Required	Provided	MR
	• Upper floors	Required	Provided	MR
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	• Size of riser/down-comer	100 mm	Provided	MR
	• Number of hydrants per floor	One	Provided	MR
	• Hose box per floor	One	Provided	MR
12.	Yard Hydrants			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose box	N/A	N/A	N/A
13.	Pumping Arrangement			
	Ground level			
	• Discharge of main pump	N/A	N/A	N/A
	• Head of main pump	N/A	N/A	N/A
	• Number of main pumps	N/A	N/A	N/A
	• Jockey pump out put	N/A	N/A	N/A
	• Jockey pump head	N/A	N/A	N/A
	• Stand by pump output	N/A	N/A	N/A
	• Stand by pump head	N/A	N/A	N/A
	• Auto starting/Manual stopping	N/A	N/A	N/A
	Terrace level			
	• Discharge of pump	450 & 180 LPM	Provided	MR
	• Head of pump	40 M (Each)	Provided	MR
	• Power supply	Required	Provided	MR
	• Auto starting of pump	Required	Provided	MR
14.	Captive Water Storage for Fire Fighting			
	• Underground tank capacity	N/A	N/A	N/A
	• Draw-off connection	N/A	N/A	N/A
	• Fire service inlet	N/A	N/A	N/A
	• Access to tank	NA	NA	NA
	• Overhead tank capacity	5,000 Ltrs	5,000 Ltrs	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of lift shaft	N/A	N/A	N/A
	• Pressurization of lift lobby	N/A	N/A	N/A
	• Communication in lift car	N/A	N/A	N/A
	• Fireman's switch	N/A	N/A	N/A
	• Lift signage	NA	NA	NA

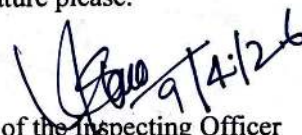
2/16

17.	Stand by Power Supply	Required	Provided	MR
18.	Refuge Area			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A
19.	Fire Control Room			
	• Detector system panel	N/A	N/A	N/A
	• Flow switch panel	N/A	N/A	N/A
	• PA system panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risk, if any:	NA	NA	NA

The fire protection systems provided in the building were tested, checked at random and found functional at the time of inspection. The shortcomings communicated by this department vide letter No. F.6/DFS/MS/EH/2026/231 dated 19/03/2026 have been complied.

Keeping in view of the substantial compliance of the minimum standard on fire prevention and fire safety measures as required under the rules, renewal of fire safety certificate issued vide letter F6/DFS/MS/EH/2023/SZ/72 dated 28/02/2023 is recommended. The last date for deemed approval is 25/04/2026.

Accordingly, DFA letter is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name: Kaushal Kishore
 Designation: ADO (SJ)

DO (SD)


10/4/26
Ravinder Singh


10/4/26
A.K. MALIK


Principal Director


CC to Secy.



11/04/26

CC to Secy


11/4/26


10/4/26
Ravinder Singh