



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No. F.6/DFS/MS/2025/NDZ/214

Dated: 29/05/2025

FIRE SAFETY CERTIFICATE

Certified that M/s **Hira Sweets and Confectionary Pvt. Ltd** located at Shop No.-10, Ground floor, Infinity S.K. Mall, Karkardooma Metro Station, Shahdara, Delhi-110092, building comprised of Ground & 02 upper floor but the restaurant at ground floor only, owned/occupied by M/s Hira Sweets & Confectionary Pvt. Ltd have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officers concerned of this department on 16/05/2025 in the presence of Mr. Parveen Sharma (Manager) and that the said premise is fit for occupancy class "**Assembly**" **Group D (Restaurant at Ground floor only)** and valid up to **31/03/2028** in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 29/05/2025 at New Delhi by

(ATUL GARG)
DIRECTOR
DELHI FIRE SERVICE

Copy to: -

1. The Addl. Commissioner of Police (Lic.), 1st Floor, Police Station Defence Colony, New Delhi-110049 (w.r.t. Online ID: **2025041206282 dated 09/05/2025**)
2. Mr. Ratna Prakash Kar, M/s Hira Sweets and Confectionary Pvt. Ltd located at Shop No.10, Ground floor, Infinity S.K. Mall, Karkardooma Metro Station, Shahdara, Delhi-110092

Conditions for the validity of Fire Safety Certificate:

1. **This FSC is valid only for Ground Floor.**
2. All the fire safety arrangement provided therein shall be maintained in good working conditions at all times. Loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. The trained fire fighting staff shall be available round the clock.
4. Any deviation with regard to the construction etc. shall be verified by the concerned building sanctioning agency.
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.
7. The owner/occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on www.dfs.delhigovt.nic.in

INSPECTION REPORT

1.	Name & address of the building	Hira Sweets and Confectionary Pvt. Ltd located at Shop No. 10, Ground floor, Infinity S.K Mall, Karkardooma Metro Station, Shahdara, Delhi-110092		
2.	Type of Occupancy	Assembly, Group D (Eating House)		
3.	Building Comprised of	Ground + 02 upper floors but Eating House located at ground floor only.		
4.	Type of Case	New		
5.	Details of previous NOC No.	Nil		
6.	Fire safety directives letter No.	F.6/DFS/MS/BP/2004/194 dated 14/06/2025 in r/o PD Area, Karkardooma Metro Station		
7.	Date of inspection	16/05/2025		
8.	Name of the Inspecting Officer	DO (ED) and ADO (SJ)		
9.	Name and designation of Officer from the building side	Sh. Parveen Sharma (Manager)		
10.	Year of Construction	2024		
11.	Applicant's letter No./Online Appl	No. 2025041206282 dated 09/05/2025		
S. No.	Minimum standards on fire prevention and fire safety U/R 33	Requirements	Provided at site	Remarks MR/NMR
1.	Access of building (PD Area FSC No. F6/DFS/MS/Metro/2025/NDZ/169 Dt. 07/04/2025)			
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	Restt. within Infinity SK Mall	As above As above As above	MR N/A N/A
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases	Provided & Maintained by Mall Mgmt.		
	<ul style="list-style-type: none"> Upper floors Basements 	N/A N/A	As above As above	N/A N/A
	b. Width of staircases	Provided & Maintained by Mall Mgmt.		
	<ul style="list-style-type: none"> Upper floors Basements 	N/A N/A	As above As above	N/A N/A
	c. Protection of exits	Provided & Maintained by Mall Mgmt.		
	<ul style="list-style-type: none"> Fire check door Pressurization 	N/A N/A	As above As above	N/A N/A
	d. No of continuous staircase to terrace	N/A	As above	N/A
	e. Width of Corridor	N/A	As above	N/A
	f. Door Size	2m & 1.50m	2m & 1.50m	MR
3.	Compartmentation	Provided & Maintained by Mall Mgmt.		
	<ul style="list-style-type: none"> Fire check door Sealing of electrical shafts Fire Rating of shaft door Water Curtain Fire Dampers 	N/A N/A N/A N/A N/A	As above As above As above As above As above	N/A N/A N/A N/A N/A
4.	Smoke Managements System	Provided & Maintained by Mall Mgmt.		
	<ul style="list-style-type: none"> Basements Kitchen Area 	N/A Required	N/A Provided	N/A MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types ISI marking 	04 Nos ABC / CO ₂ ISI marked	Provided ABC & CO ₂ Provided	MR MR MR
6.	First-Aid Hose Reels	Provided & Maintained by Mall Mgmt.		
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	One (Near Restt.) 30 mtr 05 mm	Provided Provided Provided	MR MR MR

7.	Automatic fire detection and alarming system. (Provided & Maintained by Mall Mgmt.)			
	• Type of detector	N/A	Heat & Smoke	N/A
	• Location of Main Panel	N/A	Ground floor	N/A
	• Location of Repeater Panel	N/A	Provided	N/A
	• Alternate source of power	N/A	Provided	N/A
	• Hooters' Location	N/A	Provided	N/A
8.	MOEFA	Required	Provided	MR
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	Provided & Maintained by Mall Mgmt.			
	• Basements	N/A	As above	N/A
	• Upper Floor	N/A	As above	N/A
	• Sprinkler above false ceiling	N/A	As above	N/A
11.	Internal Hydrants			
	Provided & Maintained by Mall Mgmt.			
	• Size of riser/down- comer	150 mm	Provided	MR
	• Number of hydrants per floor	One (Near Restt.)	Provided	MR
	• Hose Box	Required	Provided	MR
12.	Yard Hydrants			
	Provided & Maintained by Mall Mgmt.			
	• Total number of hydrants	N/A	As above	N/A
	• Hose Box	N/A	As above	N/A
13.	Pumping Arrangements			
	Provided & Maintained by Mall Mgmt.			
	• Ground Level	Common pump house with Metro Station		
	➤ Discharge of main pump	2850 LPM	2850 LPM	MR
	➤ Head of main pump	60m	60 mtr	MR
	➤ Number of main pumps	One	One	MR
	➤ Jockey pump out put	180 LPM	Provided	MR
	➤ Jockey pump head	60m	Provided	MR
	➤ Standby Pump out put	2850 LPM	2850 LPM	MR
	➤ Standby Pump Head	60m	Provided	MR
	➤ Auto Staring/Manual stopping	Required	Provided	MR
	➤ Pump House Access	Required	Provided	MR
	• Terrace level	Provided & Maintained by Mall Mgmt.		
	➤ Discharge of pump	450 LPM	Provided	MR
	➤ Head of the pump	40 mtr	Provided	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14.	Captive water Storage for fire fighting			
	Provided & Maintained by Mall Mgmt.			
	• Underground tank capacity	2,00,000 ltrs	As above	MR
	➤ Draw of connection	Required	As above	MR
	➤ Fire service inlet	Required	As above	MR
	➤ Access to tank	Required	As above	MR
	• Overhead Tank capacity	20,000 ltrs	As above	MR
15.	Exit Signage			
	Required			
16.	Provision of Lifts			
	Provided & Maintained by Mall Mgmt.			
	➤ Pressurization of Lift Shaft	N/A	As above	N/A
	➤ Pressurization of lift lobby	N/A	As above	N/A
	➤ Communication in lift Car	N/A	As above	N/A
	➤ Fireman's Grounding Switch	N/A	As above	N/A
	➤ Lift Signage	N/A	As above	N/A
17.	Standby Power Supply			
	Required			
18.	Refuge Area			
	➤ Total area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A

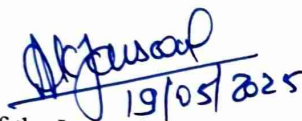
N-5


19.	Fire Control Room	Provided & Maintained by Mall Mgmt.		
	➤ Detector system panel	N/A	As above	N/A
	➤ Flow Switch Panel	N/A	As above	N/A
	➤ PA System Panel	N/A	As above	N/A
	➤ Battery backup	N/A	As above	N/A
	➤ Building Floor Plans	N/A	As above	N/A
20.	Special Fire Protection Systems for Protection of Special Risks, if any;	N/A	As above	N/A

The fire protection systems provided in the building/premises were checked, tested at random and found functional at the time of inspection. Further, the main building (PD Area) has already been issued FSC vide letter No. F6/DFS/MS/Metro/2025/NDZ/169 dated 07/04/2025

In view of the substantial compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, issue of the Fire Safety Certificate, under rule 35 of the Delhi Fire Service Rules, 2010 is recommended.

Accordingly, DFA is put up for approval and signature please.


Signature of the Inspecting Officer
Name: Ashok Kumar Jaiswal
Designation: DO (ED)



Signature of the Inspecting Officer
Name: Santosh Kumar
Designation: ADO (SJ)

~~Dy. CFO (NDZ)~~


20/05/25

C.F.O.


22/5/2025


Director

23/5/25



Sir, F.T letter is pending for your sig. pl


Director
24/5/25


20/5/25


30/5/25