



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001



No. F.6/DFS/MS/School/2026/SZ/ 66

Dated: 05/06/2026

FIRE SAFETY CERTIFICATE

Certified that the **J.B.M Public School** located at Nasir Pur, New Delhi-110045, earlier running at ground plus two upper floors in the building comprised of ground plus three floors, owned/occupied by J.B.M Public School, was issued Fire Safety Certificate by this department vide letter No. F6/DFS/MS/School/2024/SZ/1175 dated 10/12/2024. Now, on receipt of request from school management regarding utilization of third floor of the building for school activities, the premise was re-inspected by the officer concerned of this department on 27/05/2026 in the presence of Dr. Amit Solanki (Manager) and found that the school building have complied with the fire prevention and fire safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and that the said building/premise is fit (Ground plus three upper floors) for occupancy class "Educational Group B-1" with effect from 05/06/2026 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 05/06/2026 at New Delhi by


(A.K. Malik)
Chief Fire Officer (SZ)
Delhi Fire Service

Copy to: -

1. Directorate of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi-110054
2. Dr. Amit Solanki, J.B.M Public School, Nasir Pur, New Delhi-110045

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working conditions at all time as seen during inspection.
3. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
4. All the staff members must know the correct method of operation of fire-fighting system.
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, prior to its expiry.
7. The owner/occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
8. FSC issued vide letter No. F6/DFS/MS/School/2024/SZ/1175 dated 10/12/2024 shall stand null and void after issuance of this Fire Safety Certificate.

INSPECTION REPORT

1.	Name & address of the building	J.B.M. Public School located at Nasir Pur, New Delhi-110045		
2.	Type of Occupancy	Educational (Group B-1)		
3.	Building Comprised of	Ground plus three upper floors.		
4.	Type of Case	Renewal/approval for the use of 3 rd floor.		
5.	Details of previous NOC No.	F.6/DFS/MS/School/2023/SZ/191 Dt. 17/03/2023		
6.	Fire safety directives letter No.	As per NBC Part-IV		
7.	Date of inspection	27/05/2026		
8.	Name of the Inspecting Officer	ADO (JKP)		
9.	Name and designation of Officer from the building side	Dr. Amit Solanki (Manager)		
10.	Year of Construction	2002 & 2015		
11.	Applicant's letter No.	Outdoor Diary No. 1372 dated 20/05/2026		
S. No.	Minimum standards on fire prevention and fire safety U/R 33	NBC/UBBL Requirement	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	6.0 mtr	Provided	MR
	• Gate width	4.5 mtr	Directly accessible from road	MR
	• Width of internal road	N/A	N/A	N/A
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	02 Nos	04 Nos	MR
	• Basements	N/A	N/A	N/A
	b. Width of staircases			
	• Upper floors	1.50 mtr	2 x 1.5m, 1.25m, 1.20m & 1.50m ramp (GF to FF)	MR
	• Basements	N/A	N/A	N/A
	c. Protection of exits			
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	d. No of continuous staircase to terrace	02 Nos	Provided	MR
	e. Width of Corridor	1.5 mtr	Provided	MR
	f. Door Size	1.0 mtr	Provided	MR
3.	Compartmentation			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4.	Smoke Managements System			
	• Basements	N/A	N/A	N/A
	• Upper floors	Required	Natural ventilation	MR
5.	Fire Extinguishers			
	• Total numbers	10 Nos	15 Nos	MR
	• Types	ABC/CO ₂	ABC & CO ₂	MR
	• ISI marking	ISI marked	Provided	MR
6.	First-Aid Hose Reels			
	• Total numbers on each floor	01 No.	02 Nos	MR
	• Length of hose reel hose	30 mtr	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR

7.	Automatic fire detection and alarming system			
	• Type of detector	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8.	MOEFA	N/A	Provided	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	• Basements	N/A	N/A	N/A
	• Upper Floor	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	• Size of riser/down-comer	N/A	100 mm	N/A
	• Number of hydrants per floor	N/A	02 Nos	N/A
	• Hose Box	N/A	Provided	N/A
12.	Yard Hydrants			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13.	Pumping Arrangements			
	• Ground Level			
	➤ Discharge of main pump	N/A	N/A	N/A
	➤ Head of main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Staring/Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level			
	➤ Discharge of pump	450 LPM	Provided	MR
	➤ Head of the pump	40 mtr	Provided	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14.	Captive water storage for firefighting			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw of connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	10,000 ltrs	Provided	MR
15.	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	N/A	N/A	N/A
	➤ Pressurization of lift lobby	N/A	N/A	N/A
	➤ Communication in lift Car	N/A	N/A	N/A
	➤ Fireman's Grounding Switch	N/A	N/A	N/A
	➤ Lift Signage	N/A	N/A	N/A
17.	Standby Power Supply	N/A	N/A	N/A
18.	Refuge Area			
	➤ Total area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A


N-23

19.	Fire Control Room			
	➤ Detector system panel	N/A	N/A	N/A
	➤ Flow Switch Panel	N/A	N/A	N/A
	➤ PA System Panel	N/A	N/A	N/A
	➤ Battery backup	N/A	N/A	N/A
	➤ Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection Systems for Protection of Special Risks, if any;	N/A	N/A	N/A

The fire protection systems provided in the building/premises were checked, tested at random and **found functional at the time of inspection.**


In view of the deemed compliance of the minimum standards on fire prevention and fire safety as required under the rules, the fire safety certificate issued vide letter No. F6/DFS/MS/School/2024/SZ/1175 dated 10/12/2024, **recommended for approval/renewal up to 3rd Floor under rule 37 of the Delhi Fire Service Rules, 2010, FSC issued vide letter no. 1175 dated 10.12.24 shall stand null and void.**

Accordingly, DFA is put up for approval & signature please.


 Signature of the Inspecting Officer
 Name: Santosh Kumar
 Designation: ADO (JKP)

DO (SW)


 29/5/26
 RAJINDER ATWAL
 CFO (SZ)


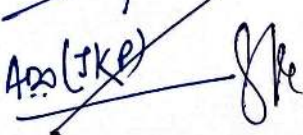

 29/5/26
 A.K. MALIK


 Principal Director


 CTO
 01/06/26


 CTO (SZ)


 1/6/26
 A.K. MALIK


 DO (SW)

 ADO (JKP)

P.F.O