



No. F6/DFS/MS/Hospital/SZ/2026/ 149

Dated: 24/07/2026

FIRE SAFETY CERTIFICATE

Certified that the Main Hospital Building (Ward Block, OPD & Old Pvt. Ward) AIIMS Complex, Ansari Nagar, New Delhi-29, comprised of Basement (Services Only) + Ground + 09 upper floors + Porta cabin (Closed) was granted Fire Safety Certificate by this department vide letter no. F6/DFS/MS/Hospital/2020/SZ/32 dated 14.01.2020. The building was re-inspected by officer concerned of this department on 29.06.2026 in the presence of Sh. Manoj AE (Electrical) & Sh. Jeeshan JE (Civil) and the building has deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of Delhi Fire Service Rules, 2010. The Medical Superintendent of the Hospital has submitted an undertaking dated 10/06/2026 stating that the Porta cabin structure on 10th floor of the Main Hospital used as Canteen shall remain closed with immediate effect. Accordingly, the premises Basement (Services Only) + Ground + 09 upper floors is fit for occupancy of "Institutional Building Group C (Hospital)" with effect from 24/07/2026 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to conditions under Rule 38 of Delhi Fire Service Rules, 2010 printed below.

Issued on 24/07/2026 at New Delhi by


(A. K. Malik)

Chief Fire Officer
Delhi Fire Service

Copy to:-

1. The Medical Superintendent, Main Hospital Building (Ward Block, OPD & old Pvt. Ward) AIIMS Complex, Ansari Naga, New Delhi-29.
2. The Executive Engineer (C) -III, AIIMS, Ansari Nagar, New Delhi-29.

Conditions for the validity of Fire Safety Certificate

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
7. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry".
8. Basement shall be used as per NBC/UBBL.
9. Any change in the occupancy shall be intimated to this Deptt. and approval shall be obtained thereto before occupancy of the same.

2/25

INSPECTION REPORT					
1	Name & address of the building		Main Hospital Building (Ward Block, OPD & Old Pvt. Ward) AIIMS Complex, Ansari Nagar, New Delhi-29.		
2	Building is comprised of		Basement (Services Only) + Ground + 09 upper floors + Porta cabin (Closed)		
3	Type of occupancy		Institutional Building Group 'C' Hospital		
4	Type of case		Renewal		
5	Details of previous FSC		F6/DFS/MS/Hospital/2020/SZ/32 dated 14.01.2020		
6	Fire safety direction letter no.		Nil (Bldg was cleared on 12 basic fire safety standards)		
7	Date of inspection		29.06.2026		
8	Name of the inspecting officers		Rajesh Kumar Shukla ADO (Jangpura)		
9	Name of the designation of officer From the building side		Sh. Manoj AE (Electrical) & Sh. Jeeshan JE (Civil)		
10	Year of construction		1950		
11	Applicant's letter no		DFS online portal application No. 52026050802783.		
S.No	Minimum Standards on fire Prevention and fire safety requirements U/R 33		Requirement as per Rule 35 (6) of DFS	Provided at Site	Remarks MR/NMR
1	Access to building				
	a	Road width	9.0 m	Provided	MR
	b	Gate width	5.0 m	Provided	MR
	c	Width of internal road	6.0 m	6.0 m on two sides	MR (old case)
2	Number, Width, Type and Arrangement of Exits				
	A	Number of staircases			
		a	Upper floor	07 nos.	03 nos. in ward block, 02 nos. in OPD 02 nos. in Old Pvt. ward
		b	Basement	02 nos.	02 nos. in ward block
					MR (old case)
	B	Width of staircases			
		a	Upper floor	1.37 m each	Ward Blk.-1.90 m, 1.40 m. & 1.5 m. OPD Blk.-1.38 m & 1.17 m, Old Pvt. Ward- 1.40 m each
		b	Basement	1.25 m each	1.40 m & 1.50 m
					MR (old case)
	C	Protection of exits			
		a	Fire check door	Required	Provided
		b	Pressurization	NA	NA
					NA
	D	No of continuous staircases to terrace		03 nos.	Provided
					MR
	E	Width of corridor		NA	1.5 m
					NA
	F	Door size		2.0 m	2.0 m & 1.5 m
					MR (old case)
3	Compartmentation				
	a	Fire check door		Required	Provided
					MR
	b	Sealing of electrical shafts		Required	Provided
					MR
	c	Fire rating of shaft door		NA	NA
					NA
	d	Water curtain		NA	NA
					NA
	e	Fire dampers		NA	NA
					NA
4	Smoke Management System.				
	a	Basement		30 ACPH	Provided
					MR
	b	Upper floor		12 ACPH	Provided
					MR

5. Fire Extinguisher				
a	Total numbers	150 nos.	150 nos.	MR
b	Types	CO ₂ & ABC & WCO ₂	CO ₂ & ABC & WCO ₂	MR
c	ISI marking	ISI marked	ISI marked	MR
6 First-aid-Hose Reels.				
a	Total numbers of each floor	BF- 2nos. GF to 5 th 7 nos. 6 th F to 8 th F- 4 nos. 9 th F- 2 nos.	Provided	MR
b	Length of hose reel hose	30 m	30 m	MR
c	Nozzle diameter	5 mm	5 mm	MR
7 Automatic fire detection and alarming system.				
a	Type of detectors	Smoke & Heat	Provided	MR
b	Location of main panel	Ground Floor	Provided	MR
c	Location of repeater panel	NA	NA	NA
d	Alternate source of power	Required	Provided	MR
e	Hooters	Audible in entire building	Provided	MR
8 MOEFA		Required	Provided	MR
9 Public address System.		Required	Provided	MR
10 Automatic Sprinkler System.				
a	Basement	Required	Provided	MR
b	Upper floors	NA	NA	NA
c	Sprinkler above false ceiling	NA	NA	NA
11 Internal Hydrants				
a	Size of riser	150 mm	Provided	MR
b	Number of hydrants per floor	BF- 2nos. GF to 5 th 7 nos. 6 th F to 8 th F- 4 nos. 9 th F- 2 nos.	Provided	MR
c	Hose Box	BF- 2nos. GF to 5 th 7 nos. 6 th F to 8 th F- 4 nos. 9 th F- 2 nos.	Provided	MR
12 Yard Hydrants.				
a	Total number of hydrants	8 nos.	8 nos.	MR
b	Hose Box	8 nos.	8 nos.	MR
13 Pumping Arrangements.				
A Ground Level				
a	Discharge of main Pump	2850 LPM	2850 LPM x 2 nos.	MR
b	Head of Main Pump	70 m	70 m	MR
c	Number of main pumps	01 no.	02 nos.	MR
d	Jockey pump out put	250 LPM	250 LPM	MR
e	Jockey pump head	70 m	70 m	MR
f	Standby pump out put	2850 LPM	2850LPM	MR
g	Standby pump head	70 m	70 m	MR
h	Auto starting /manual stopping	Required	Provided	MR
i	Pump House Access	Required	Provided	MR
B Terrace Level				
a	Discharge of pump	450 LPM	450 LPM	MR
b	Head of the Pump	40 m	40 m	MR
c	Power supply	Required	Provided	MR
d	Auto Starting of pump	Required	Provided	MR

14	Captive Water Storage for Fire Fighting.				
	a	Underground tank capacity	2,00,000 ltrs	2,00,000 ltrs	MR
	b	Draw-off connection	Required	Provided	MR
	c	Fire service inlet	Required	Provided	MR
	d	Access to tank	Required	Provided	MR
	e	Overhead Tank capacity	25,000 ltrs	Provided	MR
15	Exit Signage.		Required	Provided	MR
16	Provision of Lifts.				
	a	Pressurization of Lift Shaft	Required	Provided	MR
	b	Pressurization of Lift lobby	NA	NA	NA
	c	Communication in lift car	Required	Provided	MR
	d	Firemen's grounding switch	Required	Provided	MR
	e	Lift Signage	Required	Provided	MR
17	Standby power supply		Required	Provided	MR
18	Refuge Area.				
	a	Total area	NA	NA	NA
	b	Location	NA	NA	NA
19	Fire Control Room				
	a	Detector system panel	Required	Provided	MR
	b	Flow switch panel	NA	NA	NA
	c	PA system panel	Required	Provided	MR
	d	Battery backup	Required	Provided	MR
	e	Building Floor Plans	NA	NA	NA
20	Special Fire Protection systems for protection of special Risks, if any:		LT, HT& Transformer provided with ABC& CO2 type fire extinguishers.		MR


LEGENDS - Meeting Requirement (MR), Not Meeting Requirement (NMR), Not Applicable (NA), Provided but Not Functional (PNF).

Note:- The Medical Superintendent of the Hospital has submitted an undertaking dated 10/06/2026 stating that the Porta cabin structure on 10th floor of the Main Hospital used as Canteen shall remain closed with immediate effect.

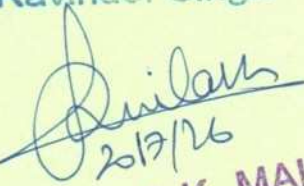
The fire protection systems provided in the building were tested, checked at random and found functional at the time of inspections.


The shortcomings issued to the Hospital by this department vide letter no. F6/DFS/MS/Hospital/2025/SZ/192 dated 25/04/2025 has been rectified by the management.


If agree to the note above & in view of the deemed compliance of minimum standards of fire prevention and fire safety measures as required under the Rules, the FSC issued vide letter no. F6/DFS/MS/Hospital/2020/SZ/32 dated 14.01.2020 is recommended to be renewed under Rule 37 of the Delhi Fire Service Rules 2010.


 Signature of the Inspecting Officer
 Name Rajesh Kumar Shukla
 Designation ADO (Jangpura)

DO (South East)


 17/7/26
 Ravinder Singh

 20/7/26
 A.K. MALIK


 A.K. MALIK

Cfo to some. 
 20/7/26
 A.K. MALIK

2/2