

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001


No. F6/DFS/MS/School/SZ/2025/ 1329

Dated: 20/11/2025

FIRE SAFETY CERTIFICATE

Certified that M.C. Primary School (1st & 2nd Shift), Village Dasghara, New Delhi-110012, is comprised of ground and first floor, was granted Fire Safety Certificate by this department vide letter No. F6/DFS/MS/School/SZ/2022/1245 dated 17.11.2022. The school building was re-inspected by the officer concerned of this department on dated 03.11.2025 in presence of Sh. Ram Awtar (Principal), and found that the school management have deemed complied with the fire prevention and fire safety requirements in accordance with the Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01-03-2011 issued by the Director of Education and that the building/ premises (ground and first floor only) is fit for occupancy class "Educational Building" w.e.f. 20/11/2025 for a period of three years, subject to compliance of the conditions printed as under.

Issued on 20/11/2025 at New Delhi by.


 (A.K. Malik)
 Dy. Chief Fire Officer
 South Zone

Copy to: -

1. Director of Education, MCD, Dr. S.P. Mukherjee Civic Centre, New Delhi- 110002.
2. The Principal, M.C. Primary School (1st & 2nd Shift), Dasghara, New Delhi- 110012.

Conditions for the Validity of Fire Safety Certificate

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non-functional of fire safety measures shall be at the risk & responsibility of the management.
3. The trained firefighting staffs should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
7. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form "J" [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.
8. All the means of escapes /exits shall not be locked/blocked at any time for safe evacuation of the occupants in case of emergency.

INSPECTION REPORT

1. Name & address of the building : M.C. Primary School, Dasghara, New Delhi- 110012.
2. Type of Occupancy : Educational
3. Building Composition : The school building is comprised of ground and first floor
4. Type of Case : Renewal
5. Details of previous NOC : F6/DFS/MS/School/SZ/2022/1245 dated 17.11.2022
6. Fire Safety directives letter No : N/A
7. Date of inspection : 03.11.2025
8. Name of the Inspecting Officers : ADO R.K. Yadav (SRD)
9. Name and designation of officers from the building side : Sh. Ram Awtar (Principal)
9. Year of Construction : 2008
10. Applicant's letter No. : Nil, dated Nil, outdoor dairy No. 6183 dated 19.09.2025


Sr. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement as per FSC dt. 17.11.2022	Provided at site	Remarks MR/NMR
1	Access to building			
	<ul style="list-style-type: none"> Road width 	06 m	Provided	MR
	<ul style="list-style-type: none"> Gate width 	-----	3.70 m	MR, old case
	<ul style="list-style-type: none"> Width of internal road 	N/A	N/A	N/A
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	-----	-----	-----
	<ul style="list-style-type: none"> Upper Floors 	02	02	MR
	<ul style="list-style-type: none"> Basements 	N/A	N/A	N/A
	b. Width of staircases	-----	-----	-----
	<ul style="list-style-type: none"> Upper Floors 	1.5 m or less & 0.75 m	1.52, 1.42 m	MR
	<ul style="list-style-type: none"> Basements 	N/A	N/A	N/A
	c. Protection of exits	-----	-----	-----
	<ul style="list-style-type: none"> Fire check door 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Pressurization 	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	01 No.	01 Nos.	MR
	g. Width of Corridor	N/A	N/A	N/A
	h. Door Size	1.0 mt	Provided (1.13 mt)	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> Fire check door 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Sealing of electrical shafts 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Fire Rating of shaft door 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Water Curtain 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Fire Dampers 	N/A	N/A	N/A
4	Smoke Management System.			
	<ul style="list-style-type: none"> Basements 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Upper floors 	N/A	N/A	N/A
5	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers 	06 nos.	Provided	MR
	<ul style="list-style-type: none"> Types 	ABC type	Provided	MR
	<ul style="list-style-type: none"> ISI marking 	ISI marked	Provided	MR
6	First-Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Length of hose reel hose 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Nozzle diameter 	N/A	N/A	N/A

N/25

Standby power supply		N/A	N/A	N/A
Refuge Area.				
➤ Total Area		N/A	N/A	N/A
➤ Location		N/A	N/A	N/A
19 Fire Control Room				
• Detector System Panel		N/A	N/A	N/A
• Flow Switch Panel		N/A	N/A	N/A
• PA System Panel		N/A	N/A	N/A
• Batter backup		N/A	N/A	N/A
• Building Floor Plans		N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	Required	01 ABC type fire extinguisher is provided near elect. Panel.	MR


The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the Fire Safety Certificate issued vide letter No. F6/DFS/MS/School/SZ/2022/1245 dated 17.11.2022, is **recommended to be renewed** under rule 37, of the Delhi Fire Service Rules, 2010.

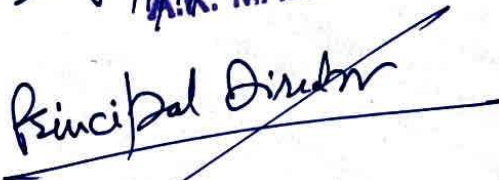

Signature of the Inspecting Officer
Name: - R.K. Yadav
Designation: - ADO (SRD)

DO (SW)



16/11/25 RAJINDER ATWAL


11/11/25


11/11/25 A.K. MALIK



Principal Director


My. Cfo (SZ)

My. Cfo to S.D.M.

11/11/25


17/11/25 A.K. MALIK


17/11/25 A.K. MALIK


A.K. MALIK

DT