

FORM 'II'  
 FORM FOR ISSUING FIRE SAFETY CERTIFICATE  
 [Refer sub - rule (1) of rule 35]  
 GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
 HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE  
 NEW DELHI

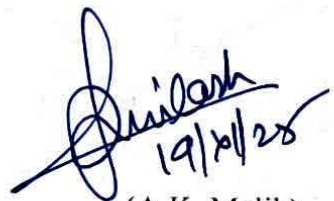
No. F6/DFS/MS/SZ/2025/1330

Dated: 20/11/2025

**FIRE SAFETY CERTIFICATE**

Certified that the building of M.C.D Primary School Located at Village Amberahi, Sector – 19, Dwarka, New Delhi – 110075, (School. ID.1757197) having 02 blocks comprised of Ground Floor & Ground + One Upper Floor was issued Fire Safety Certificate by this department vide letter No. F6/DFS/MS/2022/SZ/1124, dated 10/10/2022. The premises was re inspected by the officer concerned of this department on 04/11/2025 in the presence of Mr. Mahesh Chand Bhardwaj (Incharge). All the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore complied with the fire prevention and fire safety requirements in accordance with DOE 3298-3398 dated 1-3-2011 issued by the Director of Education and that the building/ premises is fit for occupancy class “Educational” with effect from 20/11/2025 for a period of **three years**, subject to compliance of the condition given below.

Issued on 20/11/2025 at New Delhi by.

  
 (A.K. Malik)  
 Dy. Chief Fire Officer  
 South Zone

Copy to: -

1. The M.C.D Primary School Located at Village Amberahi, Sector – 19, Dwarka, New Delhi – 110075. (School. ID.1757197)
2. Directorate of Education Old Secretariat Delhi – 110054.

**Following fire safety directives must be adhered to:-**

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).

## INSPECTION REPORT

1. Name & address of the building: M.C.D Primary School Located at Village Amberahi, Sector – 19, Dwarka, New Delhi - 110075. (School. ID.1757197)
2. Type of Occupancy : Educational (02 blocks Ground Floor & Ground +One Upper Floor)
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/2022/SZ/1124, dated 10/10/2022
5. Fire Safety directives Letter No. : DOE 3298-3398 dated 01-03-2011
6. Date of inspection : 04/11/2025
7. Name of the Inspecting Officer : ADO (DWK)
8. Name and designation of Officer  
from the building side : Mr. Mahesh Chand Bhardwaj (Incharge)
9. Year of Construction : 2012
10. Applicant's letter No. : Form J dated 09/09/2025

| S No | Minimum standards on fire prevention and fire safety U/R 33 | Requirement as per FSC dated- 10/10/2022 | Provided at site              | Remarks MR/NMR |
|------|---|--|-------------------------------|----------------|
| 1.   | Access of building  |  |                               |                |
|      | • Road width  | 06 mtr                                   | Provided                      | MR             |
|      | • Gate width  | 4.5 mtr                                  | Directly accessible from road | MR             |
|      | • Width of internal road                                    | NA                                       | NA                            | NA             |
| 2.   | Number, width, Type & Arrangements of exits                 |  |                               |                |
|      | a. Number of staircases                                     |  |                               |                |
|      | • Upper floors  | 02 Nos.                                  | 02 Nos.                       | MR             |
|      | • Basements   | NA                                       | NA                            | NA             |
|      | b. Width of staircases                                      |  |                               |                |
|      | • Upper floors  | 1.5 mtr                                  | Provided                      | MR Old Case    |
|      | • Basements   | NA                                       | NA                            | NA             |
|      | c. Protection of exits                                      |  |                               |                |
|      | • Fire check door   | NA                                       | NA                            | NA             |
|      | • Pressurization  | NA                                       | NA                            | NA             |
|      | d. No of continuous staircase to terrace                    | NA                                       | NA                            | NA             |
|      | e. Width Of Corridor  | 1.5 m                                    | Provided                      | MR             |
|      | f. Door Size  | 1 m                                      | Provided                      | MR             |
| 3.   | Compartmentation  |  |                               |                |
|      | • Fire check door   | NA                                       | NA                            | NA             |
|      | • Sealing of electrical shafts                              | NA                                       | NA                            | NA             |
|      | • Fire Rating of shaft door                                 | NA                                       | NA                            | NA             |
|      | • Water Curtain   | NA                                       | NA                            | NA             |
|      | • Fire Dampers  | NA                                       | NA                            | NA             |
| 4.   | Smoke managements System                                    |  |                               |                |
|      | • Basements   | NA                                       | NA                            | NA             |
|      | • Upper floors  | 12a/c per hour                           | Natural Ventilation provided  | MR             |




|     |  |                       |            |    |
|-----|--|-----------------------|------------|----|
| 5.  | Fire Extinguishers                           |                       |            |    |
|     | • Total numbers                              | 05 nos.               | Provided   | MR |
|     | • Types                                      | ABC & CO <sub>2</sub> | Provided   | MR |
|     | • IS marking                                 | ISI marked            | ISI marked | MR |
| 6.  | First – Aid Hose Reels                       |                       |            |    |
|     | • Total numbers on each floor                | NA                    | NA         | NA |
|     | • Length of hose reel hose                   | NA                    | NA         | NA |
|     | • Nozzle diameter                            | NA                    | NA         | NA |
| 7.  | Automatic fire detection and alarming system |                       |            |    |
|     | • Type of detectors                          | NA                    | NA         | NA |
|     | • Location of Main Panel                     | NA                    | NA         | NA |
|     | • Location of Repeater Panel                 | NA                    | NA         | NA |
|     | • Alternate source of power                  | NA                    | NA         | NA |
|     | • Hooters' Location                          | NA                    | NA         | NA |
| 8.  | MOEFA  | NA                    | NA         | NA |
| 9.  | Public Address System                        | NA                    | NA         | NA |
| 10. | Automatic Sprinkler System                   |                       |            |    |
|     | • Basements                                  | NA                    | NA         | NA |
|     | • Upper Floor                                | NA                    | NA         | NA |
|     | • Sprinkler above false ceiling              | NA                    | NA         | NA |
| 11. | Internal Hydrants:                           |                       |            |    |
|     | • Size of riser/down- comer                  | NA                    | NA         | NA |
|     | • Number of hydrants per floor               | NA                    | NA         | NA |
|     | • Hose Box                                   | NA                    | NA         | NA |
| 12. | Yard Hydrants                                |                       |            |    |
|     | • Total number of hydrants                   | NA                    | NA         | NA |
|     | • Hose Box                                   | NA                    | NA         | NA |
| 13. | Pumping Arrangements                         |                       |            |    |
|     | • Ground Level                               |                       |            |    |
|     | • Discharge of main pump                     | NA                    | NA         | NA |
|     | ➤ Head of main pump                          | NA                    | NA         | NA |
|     | ➤ Number of main pumps                       | NA                    | NA         | NA |
|     | ➤ Jockey pump out put                        | NA                    | NA         | NA |
|     | ➤ Jockey pump head                           | NA                    | NA         | NA |
|     | ➤ Standby Pump out put                       | NA                    | NA         | NA |
|     | ➤ Standby Pump Head                          | NA                    | NA         | NA |
|     | ➤ Auto Staring/Manual stopping               | NA                    | NA         | NA |
|     | ➤ Pump House Access                          | NA                    | NA         | NA |
|     | • Terrace level                              |                       |            |    |
|     | ➤ Discharge of pump                          | NA                    | NA         | NA |
|     | ➤ Head of the pump                           | NA                    | NA         | NA |
|     | ➤ Power supply                               | NA                    | NA         | NA |
|     | ➤ Auto starting of pump                      | NA                    | NA         | NA |
| 14. | Captive water Storage for fire fighting:     |                       |            |    |
|     | • Under ground tank capacity                 | NA                    | NA         | NA |
|     | ➤ Draw off connection                        | NA                    | NA         | NA |
|     | ➤ Fire service inlet                         | NA                    | NA         | NA |
|     | ➤ Access to tank                             | NA                    | NA         | NA |
|     | • Overhead Tank capacity                     | NA                    | NA         | NA |

N/23

| 15  | Exit Signage   | Required | Provided                                  | MR |
|-----|--|----------|---|----|
| 16. | Provision of Lifts   |          |   |    |
|     | ➤ Pressurization of Lift Shaft   | NA       | NA  | NA |
|     | ➤ Pressurization of lift lobby   | NA       | NA  | NA |
|     | ➤ Communication in lift Car  | NA       | NA  | NA |
|     | ➤ Fireman's Grounding Switch   | NA       | NA  | NA |
|     | ➤ Lift Signage   | NA       | NA  | NA |
| 17. | Standby power supply   | NA       | NA  | NA |
| 18. | Refuge Area  |          |   |    |
|     | ➤ Total area   | NA       | NA  | NA |
|     | ➤ Location   | NA       | NA  | NA |
| 19. | Fire control room  |          |   |    |
|     | ➤ Detector system panel  | NA       | NA  | NA |
|     | ➤ Flow Switch Panel  | NA       | NA  | NA |
|     | ➤ PA System Panel  | NA       | NA  | NA |
|     | ➤ Battery backup   | NA       | NA  | NA |
|     | ➤ Building Floor Plans   | NA       | NA  | NA |
| 20. | Special Fire Protection Systems for Protection of special Risks, if any; | Required | CO2 fire extinguisher near electric meter | MR |


The fire protection systems provided in the building were test checked and found functional at the time of inspection.

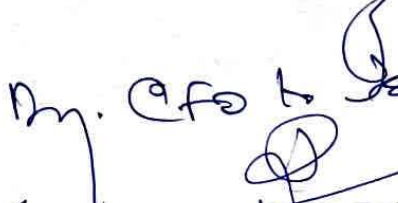
In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the ~~NOC~~ issued vide letter F6/DIFS/MS/2022/SZ/1124, dated 10/10/2022 renewal under Rule 37 of the Delhi Fire Service Rules 2010 is recommended.


  
 Signature of the Inspecting Officer  
 Name **R. K. YADAV**  
 Designation **Asst. Divi. Officer**  
**DELHI FIRE SERVICE**

  
**DO (SZ)** **7/11/25**  
**RAJINDER ATWAL**

  
**A.K. MALIK**  
**Principal Director**

  
**A.K. MALIK**  
**12/11/25**

  
**A.K. MALIK**  
**19/11/25**

  
**A.K. MALIK**  
**17/11**