



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001

7/5
आज़ादी का
अमृत महोत्सव

No. F6/DFS/MS/School/NDZ/2025/ 524

Dated: 22/04/2025

FIRE SAFETY CERTIFICATE

Certified that the MCD Primary School No. 2 located at Kalyanvas, Delhi - 110092 comprised of Ground + 01 Upper floor, owned/occupied by MCD Primary School was granted FSC by this department vide letter No. F6/DFS/MS/School/2022/ NDZ/200 dated 23/02/2022. The premises was re-inspected by the officer concerned of this department on 18/02/2022 in the presence of the Mr. Hari Mohan Meena (Principal) and found that school have deemed complied with the fire prevention and fire safety requirements in accordance with Circular No. F.16/Estate/CC/Fire Safety/2011/3298-3398 dated 01/03/2011 issued by Director of Education and the building premises is fit for occupancy of class Group B "Educational Building" Sub-Div. B-I for Gr. + 01 upper floor, with effect from 22/04/2025 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010, printed below.

Issued on 22/04/2025 at New Delhi by.

(ATUL GARG)
DIRECTOR

o/c DELHI FIRE SERVICE

Copy to:-

1. The Director of Education, East Delhi Municipal Corporation, 419, Udyog Sadan, Patparganj Industrial Area, Delhi - 110092.
2. The Principal, EDMC Primary School No. 2, Kalyanvas, Delhi - 110092.

Condition for the validity of fire safety certificate

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
7. The means of escape shall be kept unobstructed / unlocked for unhindered evacuation in case of an emergency.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry".

INSPECTION REPORT

1	Name & address of the building	MCD Primary School No. 2 located at Kalyanvas, Delhi - 110092		
2	Building is comprised of	Ground plus one upper floor		
3	Type of occupancy	Educational Building		
4	Type of case	Renewal		
5	Details of previous FSC	F6/DFS/MS/School/2022/NDZ/200 dated 23/02/2022		
6	Fire safety directives letter no.	Circular No. F.16/Estate/CC/Fire Safety/2011/3298-3398 dated 01/03/2011		
7	Date of inspection	05/03/2025		
8	Name of the inspecting officers	Yashwant Singh Meena, A.D.O/ Laxmi Nagar		
9	Name of the designation of officer from the building side	Mr. Hari Mohan Meena (Principal)		
10	Year of construction	1999		
11	Applicant's letter no.	Outdoor Dairy No. 14693 dated 19/03/2025		
S. No	Minimum standard of fire prevention and fire safety U/R 33	Circular Requirement	Provided at site	Remarks MR/NMR
1.	Access to Building:			
A	Road width	6.0 mtrs.	6.0 mtrs.	MR
B	Gate width	N/A	N/A	N/A
C	Width of internal road	N/A	N/A	N/A
2.	Number, Width, Type and Arrangement of Exits:			
A	Number of staircases			
a	Upper floor	01 no.	02 nos.	MR
b	Basement	N/A	N/A	N/A
B	Width of staircases			
a	Upper floor	1.5 mtr	1.24 & 1.30 mtr	MR
b	Basement	N/A	N/A	N/A
C	Protection of exits			
a	Fire check door	N/A	N/A	N/A
b	Pressurization	N/A	N/A	N/A
D	No. of continuous staircases to terrace	02 nos.	02 nos.	MR
E	Width of corridor	1.5 mtr	1.5 mtr.	MR
F	Door size	1.0 mtr.	1.0 mtr.	MR
3.	Compartmentation:			
A	Fire check door	NA	NA	NA
B	Sealing of electrical shafts	N/A	N/A	N/A
C	Fire rating of shaft door	N/A	N/A	N/A
D	Water curtain	N/A	N/A	N/A
E	Fire dampers	N/A	N/A	N/A
4.	Smoke Management System:			
A	Basement	N/A	N/A	N/A
B	Upper floor	N/A	N/A	N/A


5.	Fire Extinguisher:				
	A	Total numbers	10 nos.	10 nos.	MR
	B	Types	CO ₂ & ABC	CO ₂ & ABC	MR
	C	ISI marking	ISI Marked	ISI Marked	MR
6.	First-Aid-Hose Reel:				
	A	Total numbers of each floor	N/A	N/A	N/A
	B	Length of hose reel hose	N/A	N/A	N/A
	C	Nozzle diameter	N/A	N/A	N/A
7.	Automatic Fire Detection and Alarming System:				
	A	Type of detectors	N/A	N/A	N/A
	B	Location of main panel	N/A	N/A	N/A
	C	Location of repeater panel	N/A	N/A	N/A
	D	Alternate source of power	N/A	N/A	N/A
	E	Hooters	N/A	N/A	N/A
8.	MOEFA:		N/A	N/A	N/A
9.	Public Address System:		N/A	N/A	N/A
10.	Automatic Sprinkler System:				
	A	Basement	N/A	N/A	N/A
	B	Upper floor	N/A	N/A	N/A
	C	Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants:				
	A	Size of riser/down-comer	N/A	N/A	N/A
	B	Number of hydrants per floor	N/A	N/A	N/A
	C	Hose box	N/A	N/A	N/A
12.	Yard Hydrants:				
	A	Total number of hydrants	N/A	N/A	N/A
	B	Hose box	N/A	N/A	N/A
13.	Pumping Arrangements:				
1	Ground level				
	A	Discharge of main pump	N/A	N/A	N/A
	B	Head of main pump	N/A	N/A	N/A
	C	Number of main pumps	N/A	N/A	N/A
	D	Jockey pump out put	N/A	N/A	N/A
	E	Jockey pump head	N/A	N/A	N/A
	F	Standby pump out put	N/A	N/A	N/A
	G	Standby pump head	N/A	N/A	N/A
	H	Auto starting /manual stopping	N/A	N/A	N/A
	I	Pump house access	N/A	N/A	N/A
2	Terrace Level				
	A	Discharge of pump	N/A	N/A	N/A
	B	Head of the pump	N/A	N/A	N/A
	C	Power supply	N/A	N/A	N/A
	D	Auto starting of pump	N/A	N/A	N/A

4/19



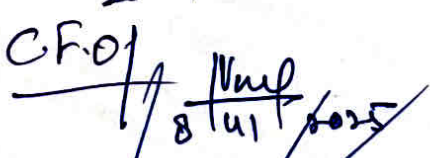

14	Captive Water Storage for Fire Fighting:			
	A	Underground tank capacity	N/A	N/A
	B	Draw-off connection	N/A	N/A
	C	Fire service inlet	N/A	N/A
	D	Access to tank	N/A	N/A
	E	Overhead tank capacity	N/A	N/A
15	Exit Signage:			
			N/A	N/A
16	Provision of Lifts:			
	A	Pressurization of lift shaft	N/A	N/A
	B	Pressurization of lift lobby	N/A	N/A
	C	Communication in lift car	N/A	N/A
	D	Firemen's grounding switch	N/A	N/A
	E	Lift signage	N/A	N/A
17	Standby Power Supply:			
			N/A	N/A
18	Refuge Area:			
	A	Total area	N/A	N/A
	B	Location	N/A	N/A
19	Fire Control Room:			
	A	Detector system panel	N/A	N/A
	B	Flow switch panel	N/A	N/A
	C	PA system panel	N/A	N/A
	D	Battery backup	N/A	N/A
	E	Building floor plans	N/A	N/A
20	Special Fire Protection systems for protection of special Risks, if any:			
			N/A	N/A

The fire protection system was randomly checked and tested and was found functional at the time of inspection.

Keeping in view of the deemed compliance of minimum standards on fire prevention and fire safety measures as required under the Rules the Fire Safety Certificate issued vide letter no. F6/DFS/MS/School/2022/NDZ/200 dated 23/02/2022 Renewal under rule 35(6) of the Delhi Fire Rules 2010 is recommended.


07/4/2025

Signature of the Inspecting Officer
Name: - Yashwant Singh Meena
Designation: - ADO (L.N)

~~D.O./EAST~~ 
Dy. C.F.O. (NDZ) 
C.F.O. 
Director 



P.T.O