



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE
NEW DELHI- 110 001

C-10
THE NEW DELHI FIRE SERVICE

No. F.6/DFS/MS/School/2025/NDZ/ 680

Dated: 21/05/2025

FIRE SAFETY CERTIFICATE

Certified that Nav Bal Vikas Vidyalaya located at 3A, New Govind Pura Ram Mandir, Street, Delhi-110051 comprised of ground plus three upper floors but school is running ground plus two upper floor (3rd floor has sealed by the owner), owned/occupied by NAV Bal Vikas Vidyalaya was issued FSC vide letter No. F.6/MS/DFS/06/1508 dated 06/07/2006. The school building was re-inspected by the officer concerned of this department on dated 05/05/2025 in the presence of Mr. Vishal (Manager) and observed that all the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore deemed complied with Circular No. 262-362 dated 17/01/2025 issued by the Director of Education and that the building/premises is fit for occupancy class 'Educational (Group-B)' (Ground to 2nd floor only) with effect from 21/05/2025 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010 & also conditions printed below.

Issued on 21/05/2025 at New Delhi by

(ATUL GARG)
DIRECTOR
DELHI FIRE SERVICE

To:-

The Manager,
Nav Bal Vikas Vidyalaya at 3A, New Govind Pura Ram Mandir Street, Delhi-110051.

Copy to:

The Dy. Director of Education, MCD
Udyog Sadan, Plot No. 419, FIE, Patparganj Ind. Area, Delhi- 110092

Conditions for the validity of Fire Safety Certificate

1. FSC is valid for ground to 2nd upper floor only. 3rd floor sealed may not be used for any purpose failing should be treated null and void.
2. All the means of escape shall be kept free of all type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the fire fighting equipment shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
6. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction /unauthorized use of land if any.
7. The owner / occupier shall apply for renewal of this Fire Safety Certificate of the Director in Form 'J' [sub rule (1) of rule (37)] along with a copy of this Certificate, Six Months prior to its expiry.
8. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of

INSPECTION REPORT

1. Name & address of the building : Nav Bal Vikas Vidyalaya,
3A, New Govind Pura, Ram Mandir, Street Delhi-110051
2. Building is comprised of : Ground plus three upper floor but school is running ground
to second floor only (3rd floor sealed by the owner)
3. Type of Occupancy : Educational
4. Type of Case : Renewal
5. Details of Previous NOC letter : F6/MS/DFS/2006/1508 Dated 06/07/2006
6. Fire Safety direction letter No : Circular No. 262-362 dated 17/01/2005
7. Date of Inspection : 05/05/2025
8. Name of the Inspecting officers : ADO (Shd.) Deepak Kumar
9. Name and designation of Officer
from the building side : Mr. Vishal
10. Year of Construction : 2000 (GF) & 2005 (1st & 2nd floor)
11. Applicant's letter No : mail ID nbpsdp21@gmail.com dated 17/03/2025


Sr. No	Minimum Standards on fire prevention and fire safety U/R33	Circular Requirement	Provided at Site	Remarks MR/NMR
01	Access to building.			
	• Road width	06 mtr.	06 mtr	MR
	• Gate width	N/A	N/A	N/A
	• Width of internal road	N/A	N/A	N/A
02	Number, Width, Type and Arrangement of Exits.			
	a. Number of Staircases			
	• Upper Floor	01 nos.	02 nos.	MR
	• Basement	N/A	N/A	N/A
	B. Width of Staircases			
	• Upper Floor	1.50 mtr	01 mtr & 1.10 mtr	MR old case
	• Basement	N/A	N/A	N/A
	c. Protection of exits			
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	d. No. of continuous staircases to terrace			
		01 nos.	01 nos.	N/A
	e. Width of Corridor	1.50 mtr.	1.50 mtr.	MR
	f. Door Size	01 mtr.	01 mtr.	MR
03	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire rating of shaft door	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
04	Smoke Management System.			
	• Basement	N/A	N/A	N/A
	• Upper floor	N/A	N/A	N/A
05	Fire Extinguishers.			
	• Total numbers	06 nos.	06 nos.	MR
	• Types	ABC /CO ₂	ABC /CO ₂	MR
	• IS marking	ISI marked	ISI marked	MR

06	First-aid-Hose Reels.	01 nos.	01 nos.	MR
	• Total numbers on each floor	30 mtr	30 mtr	MR
	• Length of hose reel hose	05 mm	05 mm	MR
	• Nozzle diameter			
07	Automatic fire detection and alarming system.			
	• Type of detectors	N/A	N/A	N/A
	• Location of main panel	N/A	N/A	N/A
	• Location of repeater panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooter's location	N/A	N/A	N/A
08	MOEFA	N/A	N/A	N/A
09	Public address System.	N/A	N/A	N/A
10	Automatic Sprinkler System.			
	• Basement	N/A	N/A	N/A
	• upper floor	N/A	N/A	N/A
	• sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• size of riser/down-comer	N/A	N/A	N/A
	• Number of hydrants per floor	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
12	Yard Hydrants.			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13	Pumping Arrangements.			
	➤ Ground Level	N/A	N/A	N/A
	• Discharge of main Pump	N/A	N/A	N/A
	• Head of Main Pump	N/A	N/A	N/A
	• Number of main pumps	N/A	N/A	N/A
	• Jockey pump out put	N/A	N/A	N/A
	• Jockey pump head	N/A	N/A	N/A
	• Standby pump out put	N/A	N/A	N/A
	• Standby pump Head	N/A	N/A	N/A
	• Auto Starting /Manual stopping	N/A	N/A	N/A
	• Pump House Access	N/A	N/A	N/A
	➤ Terrace Level			
	• Discharge of pump	N/A	N/A	N/A
	• Head of the Pump	N/A	N/A	N/A
	• Power supply	N/A	N/A	N/A
	• Auto Starting of pump	N/A	N/A	N/A
14	Captive Water Storage for Fire Fighting.			
	• Underground tank capacity	N/A	N/A	N/A
	• Draw-off connection	N/A	N/A	N/A
	• Fire service inlet	N/A	N/A	N/A
	• Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	N/A	N/A	N/A
15	Exit Signage.	2,500 ltr	2,500 ltr	MR
16	Provision of Lifts.	Required	Provided	MR
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication in lift car	N/A	N/A	N/A
	• Firemen's grounding switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A


17	Standby power supply			
18	Refuge Area.	N/A	N/A	N/A
	• Total area			
	• Location	N/A	N/A	N/A
19	Fire Control Room	N/A	N/A	N/A
	• Detector system panel	N/A	N/A	N/A
	• Flow switch panel	N/A	N/A	N/A
	• PA system panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection systems for protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety required under the rule the FSC issued vide letter No. F6/MS/DFS/2006/1508 Dated 06/07/2006 renewal under rule 35 of the Delhi Fire Service Rule, 2010 is recommended.

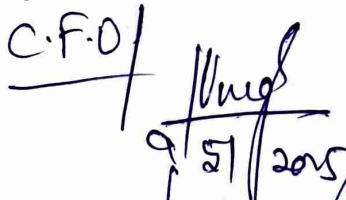
 05/05/2025
Signature of the Inspecting Officer
Name :- Deepak Kumar
Designation :- A.D.O (Shd)

DO(ED)

 06/05/2025

 06/05/25

 06/05/25

C.F.O/
 9/5/2025

Director
 9/5/25

ADD/SHD

Sir, P.T. letter is put up for your kind signature.

Director
 16/05/2025

 16/05/2025