



C-26



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE
NEW DELHI- 110 001


No. F.6/DFS/MS/School/2025/NDZ/ 739

Dated: 09/06/2025

FIRE SAFETY CERTIFICATE

Certified that the Nigam Pratibha Vidalaya located at Karkardooma, Shahdara, Delhi- 110092, comprised of ground plus one upper floor owned/occupied Nigam Pratibha Vidalaya was issued FSC vide letter No. F.6/DFS/MS/School/2022/NDZ/349 dated 31/03/22. The premises was re-inspected by the officer concerned of this department on dated 20/05/2025 in the presence of Mrs. Kamlesh Kumari, (In-charge) and observed that all the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore deemed complied with the fire prevention and fire safety requirements in accordance with Circular No. F.16/Estate/CC/Fire Safety/2011/3298 dated 01/03/2011 issued by the Director of Education and that the building/ premises is fit for occupancy class 'Educational (Group-B)' with effect from 09/06/2025 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010 & also conditions printed below.

Issued on.....09/06/2025.....at New Delhi by


(VIRENDERA SINGH)
CHIEF FIRE OFFICER

To:-

The Principal,
Nigam Pratibha Vidalaya located at Karkardooma, Shahdara, Delhi-110092

Copy to:-

The Director of Education, EDMC
Udyog Sadan, Plot No. 419, FIE, Patparganj Ind. Area, Delhi- 110092

Conditions for the validity of Fire Safety Certificate

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipment's and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipment shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
5. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction /unauthorized use of land if any.
6. The owner / occupier shall apply for renewal of this Fire Safety Certificate of the Director in Form 'J' [sub rule (1) of rule (37)] along with a copy of this Certificate, Six Months prior to its expiry.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in

1. Name & address of the building : Nigam Pratibha Vidyalaya,
Karkardooma, Shahdara, Delhi-110092
2. Building is comprised of : Ground plus one upper floor
3. Type of Occupancy : Educational
4. Type of Case : Renewal
5. Details of Previous NOC letter : F.6/DFS/MS/School/2022/NDZ/349 dated 31/03/22
6. Fire Safety direction letter No : F16/Estate/CC/Fire Safety/2011/3298 to 3398 Dated
01/03/11 (Director of Education)
7. Date of Inspection : 20/05/2025
8. Name of the Inspecting officers : ADO Deepak Kumar
9. Name and designation of Officer
from the building side : Mrs. Kamlesh Kuamri, (In-charge)
10. Year of Construction : 2007
11. Applicant's letter No : mail dated 28/04/2025

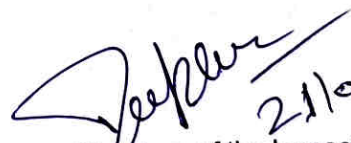
Sr. No.	Minimum Standards on fire prevention and fire safety U/R33	DoE Circular Requirement	Provided at Site	Remarks MR/NMR
01	Access to building			
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	06mtrs N/A N/A	07 mtr. N/A N/A	MR N/A N/A
02	Number, Width, Type and Arrangement of Exits			
	a. Number of Staircases <ul style="list-style-type: none"> Upper Floor Basement B. Width of Staircases <ul style="list-style-type: none"> Upper Floor Basement c. Protection of exits <ul style="list-style-type: none"> Fire check door Pressurization d. No. of continuous staircases to terrace	02 nos. N/A 1.50 mtr. N/A N/A N/A 05 nos. 1.50 mtr. 01 mtr.	03 nos. N/A 1.80 mtrs, 1.80 mtrs & 1.50 mtrs N/A N/A N/A 05 nos. 1.60 mtr. 01 mtr.	MR N/A MR N/A N/A N/A MR MR MR
03	Compartmentation.			
	<ul style="list-style-type: none"> Fire check door Sealing of electrical shafts Fire rating of shaft door Water curtain Fire Dampers 	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
04	Smoke Management System.			
	<ul style="list-style-type: none"> Basement Upper floor 	N/A N/A	N/A N/A	N/A N/A

05.	Fire Extinguishers			
		05 nos.	05 nos.	MR
	• Total numbers	ABC /CO ₂	ABC /CO ₂	MR
	• Types	ISI marked	ISI marked	MR
	• IS marking			
06	First-aid-Hose Reels.			
	Total numbers on each floor	N/A	N/A	N/A
	• Length of hose reel hose	N/A	N/A	N/A
	• Nozzle diameter	N/A	N/A	N/A
07	Automatic fire detection and alarming system.			
	• Type of detectors	N/A	N/A	N/A
	• Location of main panel	N/A	N/A	N/A
	• Location of repeater panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooter's location	N/A	N/A	N/A
08	MOEFA	N/A	N/A	N/A
09	Public address System.	N/A	N/A	N/A
10	Automatic Sprinkler System.			
	• Basement	N/A	N/A	N/A
	• upper floor	N/A	N/A	N/A
	• sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• size of riser/down-comer	N/A	N/A	N/A
	• Number of hydrants per floor	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
12	Yard Hydrants.			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13	Pumping Arrangements.			
	• Ground Level	N/A	N/A	N/A
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main Pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby pump out put	N/A	N/A	N/A
	➤ Standby pump Head	N/A	N/A	N/A
	➤ Auto Starting /Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace Level			
	➤ Discharge of pump	N/A	N/A	N/A
	➤ Head of the Pump	N/A	N/A	N/A
	➤ Power supply	N/A	N/A	N/A
	➤ Auto Starting of pump	N/A	N/A	N/A


14	Captive Water Storage for Fire Fighting.	N/A	N/A	N/A
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	N/A	N/A	N/A
15	Exit Signage.	N/A	N/A	N/A
16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication in lift car	N/A	N/A	N/A
	• Firemen's grounding switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector system panel	N/A	N/A	N/A
	• Flow switch panel	N/A	N/A	N/A
	• PA system panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection systems for protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested/checked and found functional at the time of inspection.

Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rule, the FSC issued vide letter no. : F.6/DFS/MS/School/2022/NDZ/349 dated 31/03/22 renewal under 35 of the Delhi Fire Service rules 2010, is recommended.

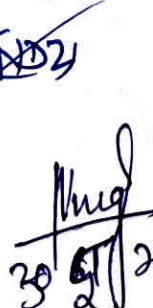

 Signature of the Inspecting Officer
 Name :- Deepak Kumar
 Designation :- A.D.O (Shd)

DO(ED)


 21/05/2025

By C.F.O. / 2022

C.F.O.


 23/05/2025

30/05/2025