




Dated: 02/07/2025

No. F6/DFS/MS/School/NDZ/2025/ 843

**FIRE SAFETY CERTIFICATE**

Certified that the **Oracle Public School** located at **C - 82, Matke Wali Gali, Gali No.11, Chouhan Banger, New Seelampur, Delhi - 110053**, building comprised of ground plus three upper floors, owned/occupied by **Oracle Public School** was granted Fire Safety Certificate by this department vide letter No. F6/DFS/MS/School/2019/NDZ/1855 dated 24/09/2019. The School building was re-inspected by the officer concerned of this department on 24/06/2025 in presence of Mr. Mohd Asif Ansari (Manager) and found that school have deemed complied with the fire prevention and fire safety requirements in accordance with NBC Part IV and the building premises is fit for occupancy of class Group B "**Educational Building**" for ground plus three upper floors with effect from 02/07/2025 for a period of **three years** in accordance with rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules 2010, printed below.

Issued on 02/07/2025 at New Delhi by.

  
(ATUL GARG)  
DIRECTOR  
DELHI FIRE SERVICE

**Copy to: -**

1. The Dy. Director of Education, East Delhi Municipal Corporation, 419, Udyog Sadan, Patparganj Industrial Area, Delhi - 110092.
2. The Principal, Oracle Public School, C - 82, Matke Wali Gali, Gali No.11, Chouhan Banger, New Seelampur, Delhi - 110053.

**Conditions for the validity of Fire Safety Certificate**

1. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipment and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the firefighting equipment shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc. may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).

# INSPECTION REPORT

N/15

1	Name & address of the building	Oracle Public School located at C - 82, Matke Wal Gali, Gali No.11, Chouhan Banger, New Seelampur, Delhi - 110053.		
2	Building is comprised of	Ground plus three upper floors		
3	Type of occupancy	Educational Building		
4	Type of case	Renewal Case		
5	Details of previous FSC	F6/DFS/MS/School/2019/NDZ/1855 dated 24/09/2019		
6	Fire safety directives letter no.	NBC Part IV		
7	Date of inspection	24/06/2025		
8	Name of the inspecting officers	Yashwant Singh Meena, ADO / Laxmi Nagar &		
9	Name of the designation of officer from the building side	Mr. Mohd Asif Ansari (Manager)		
10	Year of construction	2008		
11	Applicant's letter no.	Outdoor Diary No. 2022 dated 23/05/2025		
S. No	Minimum standard of fire prevention and fire safety U/R 33	Requirement	Provided at site	Remarks MR/NMR
1.	<b>Access to Building:</b>			
	A Road width	6.0 meters.	5.0 meters.	MR(Old case)
	B Gate width	N/A	N/A	N/A
	C Width of internal road	N/A	N/A	N/A
2.	<b>Number, Width, Type and Arrangement of Exits:</b>			
	A Number of staircases			MR
	a Upper floor	01 nos.	02 nos.	N/A
	b Basement	N/A	N/A	
	B Width of staircases			MR
	a Upper floor	1.50 mtr. & 0.75 mtr.	1.5 mtr. & 1.20 mtr.	N/A
	b Basement	N/A	N/A	
	C Protection of exits			N/A
	a Fire check door	N/A	N/A	N/A
	b Pressurization	N/A	N/A	
	D No. of continuous staircases to terrace	01 nos.	01 nos.	MR
	E Width of corridor	1.50 meters	1.50 meters	MR
	F Door size	1.0 meter	1.0 meter	MR
3.	<b>Compartmentation:</b>			
	A Fire check door	NA	NA	NA
	B Sealing of electrical shafts	N/A	N/A	N/A
	C Fire rating of shaft door	N/A	N/A	N/A
	D Water curtain	N/A	N/A	N/A
	E Fire dampers			
4.	<b>Smoke Management System:</b>			
	A Basement	N/A	N/A	N/A
	B Upper floor	N/A	N/A	N/A

② d

Delhi - 110053.

5.	Fire Extinguisher:				
	A	Total numbers	08 nos.	08 nos.	MR
	B	Types	CO <sub>2</sub> & ABC	CO <sub>2</sub> & ABC	MR
	C	ISI marking	ISI Marked	ISI Marked	MR
6	First-Aid-Hose Reel:				
	A	Total numbers of each floor	01 no.	01 no.	MR
	B	Length of hose reel hose	30 m	30 m	MR
	C	Nozzle diameter	05 mm	05 mm	MR
7	Automatic Fire Detection and Alarming System:				
	A	Type of detectors	N/A	N/A	N/A
	B	Location of main panel	N/A	N/A	N/A
	C	Location of repeater panel	N/A	N/A	N/A
	D	Alternate source of power	N/A	N/A	N/A
	E	Hooters	N/A	N/A	N/A
8	MOEFA:		N/A	N/A	N/A
9	Public Address System:		N/A	N/A	N/A
10	Automatic Sprinkler System:				
	A	Basement	N/A	N/A	N/A
	B	Upper floor	N/A	N/A	N/A
	C	Sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants:				
	A	Size of riser/down-comer	N/A	N/A	N/A
	B	Number of hydrants per floor	N/A	N/A	N/A
	C	Hose box	N/A	N/A	N/A
12	Yard Hydrants:				
	A	Total number of hydrants	N/A	N/A	N/A
	B	Hose box	N/A	N/A	N/A
13	Pumping Arrangements:				
1	Ground level				
	A	Discharge of main pump	N/A	N/A	N/A
	B	Head of main pump	N/A	N/A	N/A
	C	Number of main pumps	N/A	N/A	N/A
	D	Jockey pump out put	N/A	N/A	N/A
	E	Jockey pump head	N/A	N/A	N/A
	F	Standby pump out put	N/A	N/A	N/A
	G	Standby pump head	N/A	N/A	N/A
	H	Auto starting /manual stopping	N/A	N/A	N/A
	I	Pump house access	N/A	N/A	N/A
2	Terrace Level				
	A	Discharge of pump	450 LPM	450 LPM	MR
	B	Head of the pump	40 m	40 m	MR
	C	Power supply	Required	Provided	MR
	D	Auto starting of pump	Required	Provided	MR

<b>14</b>	<b>Captive Water Storage for Fire Fighting:</b>			
	<b>A</b>	Underground tank capacity	N/A	N/A
	<b>B</b>	Draw-off connection	N/A	N/A
	<b>C</b>	Fire service inlet	N/A	N/A
	<b>D</b>	Access to tank	N/A	N/A
	<b>E</b>	Overhead tank capacity	10,000 liters.	10,000 liters.
<b>15</b>	<b>Exit Signage:</b>		Required	Provided
<b>16</b>	<b>Provision of Lifts:</b>			
	<b>A</b>	Pressurization of lift shaft	N/A	N/A
	<b>B</b>	Pressurization of lift lobby	N/A	N/A
	<b>C</b>	Communication in lift car	N/A	N/A
	<b>D</b>	Firemen's grounding switch	N/A	N/A
	<b>E</b>	Lift signage	N/A	N/A
<b>17</b>	<b>Standby Power Supply:</b>		N/A	N/A
<b>18</b>	<b>Refuge Area:</b>			
	<b>A</b>	Total area	N/A	N/A
	<b>B</b>	Location	N/A	N/A
<b>19</b>	<b>Fire Control Room:</b>			
	<b>A</b>	Detector system panel	N/A	N/A
	<b>B</b>	Flow switch panel	N/A	N/A
	<b>C</b>	PA system panel	N/A	N/A
	<b>D</b>	Battery backup	N/A	N/A
	<b>E</b>	Building floor plans	N/A	N/A
<b>20</b>	<b>Special Fire Protection systems for protection of special Risks, if any:</b>		N/A	N/A


The fire protection system was randomly checked and tested and was found functional at the time of inspection.


Keeping in view of the deemed compliance of minimum standards on fire prevention and fire safety measures as required under the Rules the Fire Safety Certificate issued vide letter no. F6/DFS/MS/School/2019/NDZ/1855 dated 24/09/2019 Renewal under rule 35(6) of the Delhi Fire Rules 2010 is recommended.

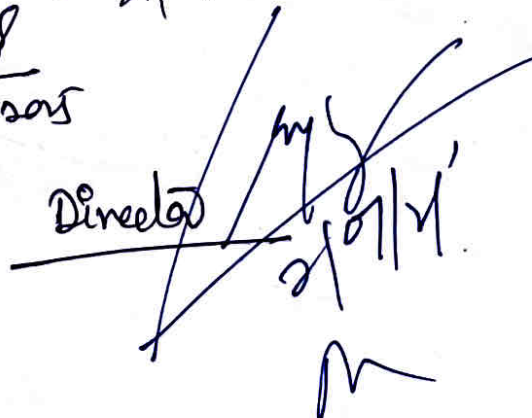
  
25/6/2025

Signature of the Inspecting Officer  
Name: Yashwant Singh Meena  
Designation: ADO /Laxmi Nagar

D.O/ED   
26/06/2025

Dy CFO/NDZ   
27/06/25

C.F.O.   
27/06/2025

Director   
27/06/25