

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS, DELHI FIRE SERVICE, NEW DELHI - 110001

No.F6/DFS/MS/SZ/2026/ 100

Dated : 30/05/2026

FIRE SAFETY CERTIFICATE

Certified that the **Plot No. 7, Ring Road , Lajpat Nagar -IV New Delhi** belong to **M/s Kamala Software Pvt Ltd** comprised of B + Stilt +Gr. + 03Upper floors, has complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officers concerned of this department on 23/05/2026 along with Sh. Sonu Misra and found that the premises is fit for occupancy class Mixed Occupancy (Mercantile & Educational) with effect from 30/05/2026..... for period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules 2010 printed below.

Issued 30/05/2026 at New Delhi by.


(A.K. Malik)
Chief Fire Officer


Copy to:

- (1) The Assistant Engineer (B), Central Zone ,Building Department -1, Lajpat Nagar, New Delhi. In r/o letter no. D/30/AE(B)IV/CZ/2026 dated 08.05.2026 to kindly ensure the occupancy and deviation in construction if any under intimation to this department.
- (2). The Director, M/S Kamala Software Private Ltd at Plot No. 7, Ring Road, Lajpat Nagar – IV New Delhi.

Condition for the validity of fire safety certificate

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation w.r.t. construction, lift , electrical installation, set back area etc. shall be verified by the sanctioning authority concerned.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
7. The means of escape shall be kept unobstructed / unlocked for unhindered evacuation in case of an emergency.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry".
9. Any flammable material for interior decoration shall strictly be prohibited.
10. Basement shall be used strictly as per BBL concerned and lift shall not be served to basement as per undertaking otherwise this FSC shall stand null and void.

INSPECTION REPORT

1. Name & address of the building : Plot No. 7 , Ring Road Lajpat Nagar IV
New Delhi.(M/S Kamal Software Pvt Ltd .)
2. Type of occupancy : Mixed Occupancy (Mercantile & Educational)
(basement +stilt + Gr. + 03 Upper floors only)
Stilt -Parking, Ground (Showroom) & upper floors
Office & Coaching classes
3. Type of case:- : New
4. Details of previous NOC : N/A
5. Fire safety directives No. : As per UBBL/ NBC Part-4
6. Date of inspection:- : 23/05/26
7. Name of the inspecting officer : Sh. Yashawant Singh Meena, ADO(MR)
Sh. Ravinder Singh, DO (SD)
8. Name & designation of officer
From the building side : Mr. Sonu Misra
9. Year of construction : 2020
10. Applicant's letter No : D/30/AE(B)IV/CZ/2026 dated 08.05.2026 &
Applicant letter dated 09.05.2026

S.No.	Minimum Standards on fire Prevention and fire safety U/R 33	Requirements	Provided at site	Remarks MR/NMR
1.	Access to Building			
	1) Road width	06 mtr.	Provided	MR
	2) Gate width	N/A	Directly accessible	N/A
	3)Width of internal road	N/A	N/A	N/A
2.	Number, Width Type & Arrangement of Exits			
	A. Number of staircases			
	1. Upper floors	02 nos	Provided	MR
	2. Basements	02 nos	Provided	MR
	B. Width of staircase			
	1. Upper floors	1.5 mtr each	Provided	MR
	2. Basements	1.5 mtr each	Provided	MR
	C. Protection of exits			
	1. Fire check door	Required in basement	Provided	MR
	2. Pressurization	N/A	N/A	N/A
	D. No. of continuous staircase to terrace	02	02	MR
	E. Width of corridor	1.8 m	Provided	MR
	F. Door size	1.5m	Provided	MR
3.	Compartmentation			
	1) Fire check door	Required in basement	Provided	MR
	2) Sealing of electrical shafts	Required	Provided	MR
	3) Fire rating of shaft door	N/A	N/A	N/A
	4) Water curtain	N/A	N/A	N/A
	5) Fire Dampers	N/A	N/A	N/A
4.	Smoke Management System			
	1) Basements	Required	Provided	MR

	2) Upper floors	Required	Provided	MR
5.	Fire Extinguishers			
	1) Total numbers	12 nos	Provided	MR
	2) Types	ABC & CO2	Provided	MR
	3) ISI marking	ISI marked	Provided	MR
6.	First-Aid Hose Reel			
	1) Total number of each floor	01Nos.	02 nos	MR
	2) Length of hose reel hose	30 mtr.	Provided	MR
	3) Nozzle diameter	05 mm	Provided	MR
7.	Automatic Fire Detection & Alarming System			
	1) Type of detectors smoke	N/A	Provided	N/A
	2) Location of main panel	N/A	Provided	N/A
	3) Location of repeater panel	N/A	N/A	N/A
	4) Alternate source of power	N/A	Provided	N/A
	5) Hooter's Location	N/A	Provided	N/A
8.	MOEFA	Required	Provided	MR
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	1) Basement	Required	Provided	MR
	2) Upper floors	N/A	Provided	N/A
	3) Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	1) Size of riser/down-comer	100mm	Provided	MR
	2) Number of hydrants per floor	01Nos.	02 nos	MR
	3) Hose box each floor	01Nos.	02 nos	MR
12.	Yard Hydrants			
	1) Total number of hydrants	N/A	01nos	N/A
	2) Hose box	N/A	Provided	N/A


13.	Pumping Arrangement			
	1) Ground level			
	a) Discharge of main pump	N/A	N/A	N/A
	b) Head of main pump	N/A	N/A	N/A
	c) Number of main pump	N/A	N/A	N/A
	d) Jockey pump out put	N/A	N/A	N/A
	e) Jockey pump head	N/A	N/A	N/A
	f) Stand by pump output	N/A	N/A	N/A
	g) Stand by pump head	N/A	N/A	N/A
	h) Auto starting/Manual stopping	N/A	N/A	N/A
	2) Terrace level			
	a) Discharge of pump	900 LM & 450 LPM	Provided	MR
	b) Head of pump	40m	40 m	MR
	c) Power supply	Required	Provided	MR
	d) Auto starting of pump	Required	Provided	MR
14.	Captive Water Storage for Fire Fighting			

	1) Under ground tank capacity	N/A	N/A	N/A
	a) Draw-off connection	N/A	N/A	N/A
	b) Fire service inlet	N/A	N/A	N/A
	c) Access to tank	N/A	N/A	N/A
	d) Over head tank capacity	30,000 ltr.	MR	MR
15.	Exit Signage.	Required	MR	MR
16.	Provision of Lifts.			
	a) Pressurization of lift shaft	N/A	N/A	N/A
	b) Pressurization of lift lobby	N/A	N/A	N/A
	c) Communication in lift car	Required	Provided	MR
	d) Fireman's switch	Required	Provided	MR
	e) Lift signage	Required	Provided	MR
17.	Stand by Power Supply	Required	Provided	MR
18.	Refuge Area	N/A	N/A	N/A
	Total area location	N/A	N/A	N/A
19.	Fire Control Room			
	a) Detector system panel	N/A	N/A	N/A
	b) Flow switch panel	N/A	N/A	N/A
	c) PA system panel	N/A	N/A	N/A
	d) Battery backup	N/A	N/A	N/A
	e) Building floor plan	N/A	N/A	N/A
20	Special Fire Protection System for Protection of special Risk, if any:	Required	Provided	MR

The fire protection systems provided in the building were randomly tested, checked and found functional at the time of inspection. Further, lift serving to basement has been closed/sealed and undertaking of the same on dated 23.05.2026 is enclosed and places on file at C-47.


In view of the substantial compliance of the minimum standards of fire prevention and fire safety measures as required under DFS rules. The FSC is recommended to issue. Accordingly, DFA letter is prepared and put up for kind perusal, approval and signature please.

Signature of the Inspecting Officer


26/5/26

Name :- Ravinder Singh
Designation: DO (SD)

Signature of the Inspecting Officer


26/5/2026

Name : Yashwant Singh Meena
Designation :- ADO(M Road)

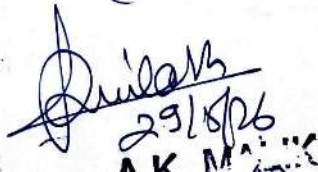
CFD/57


27/5/26


A.K. MALIK

Principal Director

CFD to Secy.


29/5/26
A.K. Malik

CFD (Secy)


28/5/26