

C/22



75
Azadi Ka
Amrit Mahotsav

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No. F.6/DFS/MS/2025/SZ/ 46

Dated: 27/01/2025

FIRE SAFETY CERTIFICATE

Certified that the **Sports Complex** (Centre of Excellence for Wrestling, Boxing Judo Karte, Kabaddi etc. & Swimming Pool, Change Room cum Cafeteria Block) located at Sector-08, Dwarka, New Delhi-110077, each comprised of Ground plus one upper floor only, owned/occupied by Delhi Development Authority, have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officers concerned of this department on dated 09/01/2025 in the presence of Sh. Sachidanand, AE (Elect.) and that the said building/premises is fit for occupancy class "**Assembly**" with effect from the issuance of this certificate for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 27/01/2025 at New Delhi by

(ATUL GARG)
DIRECTOR

T. No. 011-23414000

Copy to: -

1. The Executive Engineer, Delhi Development Authority, Electrical Division-3, Siri Fort, Behind Gargi College, New Delhi-110049
2. The Administrator, Sports Complex (Centre of Excellence for Wrestling, Boxing Judo Karate, Kabaddi etc.), Sector-08, New Delhi-110077

Conditions for the validity of Fire Safety Certificate:

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working conditions at all time as seen during inspection.
3. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
4. All the staff members must know the correct method of operation of fire-fighting system.
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
7. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

INSPECTION REPORT

1	Name & Address of the Building	Sports Complex (Centre of Excellence for Wrestling, Boxing, Judo Karte, Kabaddi etc.) located at Sector-08, Dwarka, New Delhi.		
2	Type of Occupancy	Assembly & Office Building		
3	Building Comprised of	Centre of excellence cum Admin Bldg: G+1 Upper Floor, Swimming pool, change room cum cafeteria block: G+1 Upper Floor.		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	F.6/DFS/MS/BP/2020/306 Dt. 24/08/2020		
7	Date of Inspection	09/01/2025		
8	Name of the Inspecting Officers	DO (CD/SW) & ADO (SJ/DWK)		
9	Name & Designation of Officers from the building side	Sh. Sachidanand, AE (Elect.)		
10	Year of construction	2019 - 2020		
11	Applicant letter No.	E-mail dated 02/01/2025		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC/UBBL Requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	30 mtr	Provided	MR
	• Gate width	06 mtr	Provided	MR
	• Width of internal road	06 mtr	Provided	MR
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase	Admin Blk-03nos Cafeteria Blk-02	Provided	MR
	➤ Upper floors.	-NA-	-NA-	-NA-
	➤ Basements	-NA-	-NA-	-NA-
	b) Width of Staircase	2 mtr	Admin Blk-3 x 2m Cafeteria Blk=2 x 2m	MR
	➤ Upper floors	-NA-	-NA-	-NA-
	➤ Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits	Required	Provided	MR
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	One ALL	Provided	MR
	e) Width of corridor	-NA-	-NA-	-NA-
	f) Door size	2m (Assembly Hall)	Provided	MR
3	Compartmentation.			
	• Fire check door.	Required	Provided	MR
	• Sealing of electrical shafts.	Required	Provided	MR
	• Fire rating of shaft door.	Required NA	Provided NA	MR
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4	Smoke Management system.			
	• Basement	-NA-	-NA-	-NA-
	• Upper floors	Required	Natural Ventilation	MR
5	Fire Extinguishers.			
	• Total numbers	Portable fire extinguishers	10 Nos each floor	MR
	• Types	ISI marked	CO ₂ & W.CO ₂	MR
	• ISI Marking		Provided	MR
6	First Aid Hose Reels.			
	• Total numbers on each floor.	Admin Blk-04nos Cafeteria Blk-02	Provided	MR
	• Length of hose-reel hose.	30m	Provided	MR
	• Nozzle Diameter	5mm	Provided	MR


7	Automatic fire detection & alarming system.			
	• Type of detectors (In Basement)	-NA-	-NA-	-NA-
	• Location of Main Panel	-NA-	-NA-	-NA-
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	-NA-	-NA-	-NA-
	• Hooter's location	-NA-	-NA-	-NA-
8	MOEFA	Required	Provided	MR
9	Public Address System	Required	Provided	MR
10	Automatic Sprinkler System			
	• Basement	-NA-	-NA-	-NA-
	• Upper floors	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
11	Internal Hydrants.			
	• Size of Riser/Down-comer	100mm	Provided	MR
	• Number of Hydrant per floor	Admin Blk-02nos Cafeteria Blk-02	Provided	MR
	• Hose box.	Admin Blk-02nos Cafeteria Blk-02	Provided	MR
12	Yard Hydrants.			
	• Total number of hydrants.	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
13	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	-NA-	-NA-	-NA-
	➤ Head of main pump.	-NA-	-NA-	-NA-
	➤ Number of main pumps.	-NA-	-NA-	-NA-
	➤ Jockey Pump output.	-NA-	-NA-	-NA-
	➤ Jockey Pump head.	-NA-	-NA-	-NA-
	➤ Standby Pump output.	-NA-	-NA-	-NA-
	➤ Standby Pump head.	-NA-	-NA-	-NA-
	➤ Auto Starting/Manual Stopping.	-NA-	-NA-	-NA-
	➤ Pump house access.	-NA-	-NA-	-NA-
	• Terrace Level			
	➤ Discharge of pump.	900 LPM	Provided	MR
	➤ Head of pump.	40m	Provided	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14	Captive water storage for fire fighting.			
	• Underground tank capacity.	-NA-	-NA-	-NA-
	➤ Draw-off connection.	-NA-	-NA-	-NA-
	➤ Fire Service Inlet.	-NA-	-NA-	-NA-
	➤ Access to tank.	-NA-	-NA-	-NA-
	• Overhead tank capacity.	25,000 Ltr	Provided	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	Required	Provided	MR
	• Fireman's switch.	Required	Provided	MR
	• Lift signage.	Required	Provided	MR
17	Standby Power Supply	Required	Provided	MR
18	Refuge Area			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-


19	Fire Control Room.			
	• MOEFA System Panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20	Special Fire Protection System for Protection of Special Risk, if any.	Required	CO ₂ fire extinguisher provided near electric panel	MR

The fire protection systems provided in the building were test checked and found functional at the time of inspection. The shortcomings issued and communicated by this department vide letter No. F6/DFS/MS/SZ/2024/633 dated 20/11/2024 found complied.


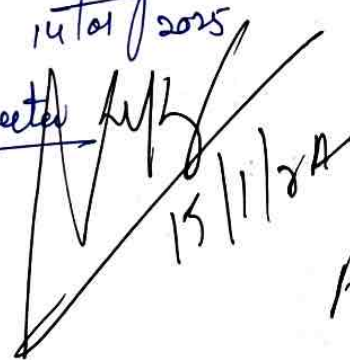
In view of the deemed compliance of the minimum standards on fire prevention and fire safety as required under the rules, grant of the fire safety certificate, under rule 35 of the Delhi Fire Service Rules, 2010 is recommended.

Accordingly, DFA is put up for approval and signature please.


Signature of the Inspecting Officer
Name: Rajinder Atwal
Designation: DO (CD/SW)


Signature of the Inspecting Officer
Name: Santosh Kumar
Designation: ADO (SJ/DWK)

CFO (HQ)


14/01/2025
Director

15/11/24
A.D.O./SJ

Sir,

F-T letter is put up for your sig. pl


Director



24/01/25