

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001

No.F6/DFS/MS/2025/BNQT/ 10

Dated 11/03/2025

FIRE SAFETY CERTIFICATE

Certified that M/s Symphony Grand Banquets located at Plot no-07, Pitampura, Delhi-110034 comprised of Basement (storage), Ground (Banquet) and First floor (Banquet) only, owned/ occupied by Grand Hospitality, was issued fire safety certificate vide letter no. F6/DFS/MS/WZ/2022/BNQT/19 Dated: 31.03.2022. The premises was inspected by the officer concerned of Fire Service on 05.03.2025 in the presence of Mr. Navdeep (Manager) and observed that all the fire prevention and fire safety arrangements as provided in the premise found good working condition. The premise have therefore deemed complied with the fire prevention and fire safety measures in accordance with the rule 33 of Delhi Fire Service Rules, 2010 and that the building / premise is fit for occupancy class "Assembly Group -D for ground & first floor only" with effect from---11/03/2025 for a period of three years, in accordance with rules 36 unless renewed under rule. 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on11/03/2025 at New Delhi by

(Ajul Garg)
 Director
 Ph.-011-23414000
 etc

Copy to :-

1. The Commissioner, Municipal Corporation of Delhi, to ensure the occupancy as detailed above deviation and if any.
2. The Joint Commissioner of Police (Lic.), First Floor, P.S. Defence Colony, New Delhi-110049, Online Portal ID No- 2025022102207 dated 25.02.2025

Conditions for the validity of Fire Safety Certificate:

1. All the means of escape shall be kept free from any type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipment and method of smooth and speedy safe evacuation of occupants in case of emergency
3. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seem during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
4. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities. This Fire Safety Certificate is valid only for permanent building structure as per plan.
5. This fire safety certificate may not be treated in any case of regularizations of unauthorized construction/unauthorized use of land or activities, if any.
6. Basement shall not be used for any other purpose except as specified in UBBL, subject to permission from concerned local authority.
7. The owner / occupier shall submit a declaration every year in Form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on the official website of Delhi Fire Service i.e. www.dfs.delhigovt.nic.in.
8. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the MHA portal along with a copy of this Certificate, **six months** prior to its expiry".

INSPECTION REPORT

1. Name & address of the building : M/s Symphony Grand Banquets, Plot No- 07, Pitampura, Delhi-110034.
2. Type of Occupancy : Assembly (Banquet Hall)
3. Composition of building : Basement + Ground+ first floor only
4. Type of Case : Renewal
5. Details of previous NOC : F6/DFS/MS/WZ/2022/BNQT/19 Dated: 31.03.2022
6. Fire Safety directives letter No : F.6/DFS/MS/BP/2022/537 dated : 08.03.2022
7. Date of inspection : 05.03.2025
8. Name of the Inspecting Officers : ADO (RN)
9. Name and designation of officers
from the building side : Mr. Navdeep (Manager)
10. Year of Construction : 2017
11. Applicant's letter No. : Online Portal ID No- 2025022102207 dated 25.02.2025

	Minimum Standards on fire prevention and fire safety U/R 33	Requirement as per fire safety guideline dated 08.03.2022	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	12m	24m	MR
	• Gate width	4.50m	Provided	MR
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	02	02	MR
	• Basements	02	02	MR
	b. Width of staircases			
	• Upper Floors	02m each	Provided	MR
	• Basements	1.50m each	Provided	MR
	c. Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	Required	Provided	MR
	d. No. of continuous staircases to terrace	02	02	MR
	e. Width of Corridor	NA	NA	NA
	f. Door Size	02m	Provided	MR
3	Compartmentation.			
	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	Required	Provided	MR
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4	Smoke Management System.			
	• Basements	Required	Provided	MR
	• Upper floors	Required	Provided	MR
5	Fire Extinguishers			

N/9


	<ul style="list-style-type: none"> Total numbers Types ISI marking 	16nos ABC & Co2 Yes	16nos 16- ABC Yes	MR MR MR
6	First-Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	01 30m 5mm	Provided Provided Provided	MR MR MR
7	Automatic fire detection and alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	NA NA NA NA NA	NA NA NA NA NA	NA NA NA NA NA
8	MOEFA	Required	Provided	MR
9	Public Address System.	Required	Provided	MR
10	Automatic Sprinkler System.			
	<ul style="list-style-type: none"> Basement Upper Floor Sprinkler above false ceiling 	Required Required Required	Provided Provided Provided	MR MR MR
11	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 	100mm 01 01	Provided 01 01	MR MR MR
12	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	NA NA	NA NA	NA NA
13	Pumping Arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/ Manual stopping Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 	N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A 900lpm & 450lpm 40m Required Required	N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A 900lpm & 450lpm Provided Provided Provided Provided	N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A MR MR MR MR
14	Captive Water Storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity 	NA	NA	NA



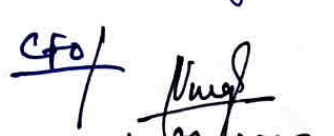

N/12

	1. Draw-off connection	N/A	N/A	N/A
	2. Fire service inlet	N/A	N/A	N/A
	3. Access to tank	Required	Provided	MR
	4. Overhead Tank capacity	30,000 ltr	Provided	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	5. Pressurization of Lift Shaft	N/A	N/A	N/A
	6. Pressurization of Lift lobby	N/A	N/A	N/A
	7. Communication In lift Car	NA	NA	NA
	8. Fireman's Grounding Switch	Required	Provided	MR
	9. Lift Signage	Required	Provided	MR
17	Standby power supply	Required	Provided	MR
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	NA	NA	NA

The fire protection systems provided in the building were tested/ checked and found some in working order at the time of inspection.

Keeping in view of the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to renew Fire Safety Certificate issued vide this department letter of even no. F6/DFS/MS/WZ/2022/BNQT/19 Dated: 31.03.2022, under rule 37 of the Delhi Fire Service Rules 2010.


 Signature of the Inspecting Officer
 Name: - C.L. Meena
 Designation:- ADO/RN



 Dy Cfo (uiz)

 Dy Cfo (uiz)

 Dy Cfo (uiz)

Am #12