

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**

No. F.6/DFS/MS/School/2025/SZ/82

Dated..30/01/2025

FIRE SAFETY CERTIFICATE

Certified that **Tamana (School)** located at **C-10, Vasant Vihar, New Delhi-110057** comprised of Basement, ground plus Two upper floors owned/occupied by Tamana School, was issued Fire Safety Certificate by this department vide letter No. F6/DFS/MS/School/2022/SZ/474 dated 29/04/2022. The premise was re-inspected by officer concerned of this department on 22/01/2025 in presence of Ms. Rubaina Juneja and found that the said school building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules 2010 and that the building is fit for occupancy class **"Educational Building Group - B"** with effect from 30/01/2025 for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of Delhi Fire Service Rules 2010.

Issued on 30/01/2025 at New Delhi by

(ATUL GARG)
DIRECTOR
DELHI FIRE SERVICE

Copy to: -

1. The Principal, Tamana (School) at C-10, Vasant Vihar, New Delhi-110057.
2. The Directorate of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi-54

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

INSPECTION REPORT

1	Name & Address of the Building	Tamana (School) at C10, Vasant Vihar, New Delhi-110057		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	Basement, Ground plus Two Upper floors		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/School/2022/SZ/474 dated 29/04/2022		
6	Fire Safety Directives Letter No	NBC Part IV 2005/ BBL-1983		
7	Date of Inspection	22-01-2025		
8	Name of the Inspecting Officers	Sh. Rajesh Kumar ADO (BCP)		
9	Name & Designation of Officers from the building side	Ms. Rubaina Juneja		
10	Year of construction	2000 & 2009		
11	Applicant letter No.	Email ID dated 21-01-2025		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC Part IV 2005/ BBL-1983	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	6 mtr	Provided	MR
	• Gate width	4.5 mtr	Provided	MR
	• Width of internal road	-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	02 Nos	Provided	MR
	➤ Basement floor.	02 Nos	Provided	MR
	b) Width of Staircase			
	➤ Upper floors	1.50m & 1.0 m	1.50 m (iron) & 1.10m	MR
	➤ Basement floor	1.50m & 1.0 m	1.50m & 1.10m	MR
	c) Protection of exits			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	One	Provided	MR
	e) Width of corridor	-NA-	-NA-	-NA-
	f) Door size	0.90 m	Provided	MR
3	Compartmentation.			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4	Smoke Management system.			
	• Basement	-NA-	-NA-	-NA-
	• Upper floors	-NA-	-NA-	-NA-
5	Fire Extinguishers.			
	• Total numbers	Required	18 Nos	MR
	• Types	ABC / CO2	ABC & Co2	MR
	• ISI Marking	ISI mark	Provided	MR
6	First Aid Hose Reels.			
	• Total numbers on each floor.	One	Provided	MR
	• Length of hose-reel hose.	30m	Provided	MR
	• Nozzle Diameter	5mm	Provided	MR
7	Automatic fire detection & alarming system.			
	• Type of detectors	-NA-	Smoke/Heat	-NA-

2/7


	<ul style="list-style-type: none"> Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	-NA-	Ground floor	-NA-
		-NA-	-NA-	-NA-
		-NA-	Provided	-NA-
		-NA-	Provided	-NA-
8	MOEFA	NA	Provided	NA
9	Public Address System	-NA-	-NA-	-NA-
10	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Upper floors Sprinkler above false ceiling 	Required	Provided	MR
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
11	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer Number of Hydrant per floor Hose box. 	-NA-	100 mm	-NA-
		-NA-	One	-NA-
		-NA-	One	-NA-
12	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. Hose box. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
13	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level 			
	<ul style="list-style-type: none"> Discharge of main pump. Head of main pump. Number of main pumps. Jockey Pump output. Jockey Pump head. Standby Pump output. Standby Pump head. Auto Starting/Manual Stopping. Pump house access. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Terrace Level 			
	<ul style="list-style-type: none"> Discharge of pump. Head of pump. Power supply. Auto starting of pump. 	900 LPM	900 LPM	MR
		40 mtr	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
14	Captive water storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. Draw-off connection. Fire Service Inlet. Access to tank. Overhead tank capacity. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		15,000 Lts	15,000 Lts	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. Pressurization of lift lobby. Communication in lift car. Fireman's switch. Lift signage. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
17	Standby Power Supply	-NA-	-NA-	-NA-
18	Refuge Area			
	<ul style="list-style-type: none"> Total area Location 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
19	Fire Control Room.			
	<ul style="list-style-type: none"> Detector system panel. Flow switch panel. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-

	<ul style="list-style-type: none"> PA system panel. Battery backup. Building floor plan. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
20	Special Fire Protection System for the Protection of special Risk, if any.	Required	ABC Type fire extinguishers provided near electrical panel	MR


The fire protection system provided in the building were randomly checked and found functional at the time of inspection.

Keeping in view of the deemed compliance of the minimum standard on fire prevention and fire safety measures as required under the rules, the FSC issued vide letter no F6/DFS/MS/School/2022/SZ/474 dated 29/04/2022, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.


Accordingly DFA is put up for approval and signature please.



 Signature of the Inspecting Officer
 Name Sh. Rajesh Kumar
 Design: ADO (BCP)

DO (SD)




CFO/MS
 24/01/2025

Director

 27/1/25

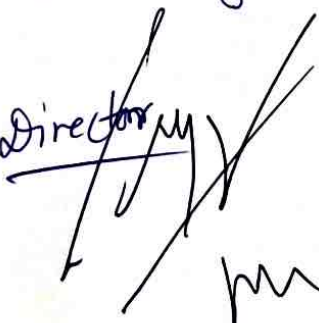

As approved, f.t letter is put up for
 Genl Signature M

Director


1/1
 29/1/24