



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001



No F6/DFS/MS/EH/SZ/2026/175

Dated: 10/08/2026

FIRE SAFETY CERTIFICATE

Certified that the M/s Mustard Madras (A Unit of Das Kitchens) located at shop no R-03, upper ground floor, Epicuria Complex TDI south Bridge mall, Upper ground floor, Nehru place Metro station, New Delhi-110019, in a building comprised of Basement, Lower Ground Floor & upper Ground Floor. The premises was inspected by the officer concerned of this department on 25/07/2026 in the presence Sh. Uday Kant Singh (mall manager) and found that the said premise have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the premise is fit for occupancy class Group-D "Assembly" (Eating House) (Restaurant is running at upper ground floor) with effect from 10/08/2026 for the period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010. Conditions mentioned below.

Issued on 10/08/2026 at New Delhi by.


(A.K. Malik)
Chief Fire Officer

Copy to:

1. The Commissioner MCD, Civic Centre, Minto Road, New Delhi- 110002.-to ensure the occupancy as detailed above & deviation if any.
2. The authorized signatory, M/s Mustard Madras (A Unit of Das Kitchens) located at shop no R-03, Epicuria Complex TDI south Bridge mall, Upper ground floor, Nehru place Metro station, New Delhi-110019. (Online Portal ID No. 2026071309755 dated- 13/07/2026).

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management/occupier.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction, lift, electrical, etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. All the means of escape shall be kept free of any obstruction all the time to evacuate the occupant. in a safe manner, in the event of emergency.

INSPECTION REPORT

1. Name & address of the building	M/s Mustard Madras (A Unit of Das Kitchens) located at shop no R-03, Epicuria Complex TDI south Bridge Mall, Nehru place Metro station, New Delhi-110019.			
2. Type of Occupancy	Group-D "Assembly" Eating House is running at upper ground floor in a building comprised of Basement, Lower Ground & Uppper Ground Floor.			
3. Type of Case	New Case			
4. Details of Previous NOC	Nil			
5. Fire Safety directives letter No	F.6/DFS/MS/2025/SZ/547 dated-08/10/2025 TDI Mall Noc			
6. Date of inspection	25/07/2026			
7. Name of Inspecting Officer	Sh. Sarabjeet Singh ADO (BCP)			
8. Name and designation of officers From the building side	Sh. Uday kant Singh (mall manager)			
9. Year of Construction	2009 (As per online application)			
10. Applicant's letter No.	Online-ID No -2026071309755 dated-13/07/2026			
S. No	Minimum Standards on fire prevention and fire safety U/R 33	BBL/NBC	Provided at site	Remarks MR/NMR
1.	Access to building	F.6/DFS/MS/2025/SZ/547 dated-08/10/2025 TDI Mall Noc ✓		
	• Road width	Restt. within Tdi mall	Provided*	MR
	• Gate width	Restt. within Tdi mall	Provided*	MR
	• Width of internal road	Restt. within Tdi mall	Provided*	MR
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	Provided & Maintained by Mall		
	• Upper Floors	Required	Provided	MR
	• Basements	NA	As above	NA
	b. Width of staircases	Provided & Maintained by Mall		
	• Upper Floor	2x1.5m	Provided	MR ✓
	• Basements	NA	As above	NA
	c. Protection of exits	Provided & Maintained by Mall		
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	Required	02 nos.	MR
	e. Width of Corridor	NA	NA	NA
	f. Door Size	1.5m each	Provided	MR ✓
3.	Compartmentation	Provided & Maintained by Mall		
	a) Fire check door	NA	NA	NA
	b) Sealing of electrical shafts	NA	NA	NA
	c) Fire Rating of shaft door	NA	NA	NA
	d) Water Curtain	NA	NA	NA
	e) Fire Dampers	NA	NA	NA
4.	Smoke Management System	Provided & Maintained by Mall		
	a) Basements	NA	NA	NA
	b) Upper floors	Required	Provided	MR
5.	Fire Extinguishers			
	a) Total numbers	04 nos.	10 nos.	MR
	b) Types	ABC/CO ₂	ABC/CO ₂	MR
	c) IS marking	ISI marked	Provided	MR


6.	First-Aid Hose Reels			
	Provided & Maintained by Mall			
	a) Total numbers on each floor	01 nos.	As above	MR
	b) Length of hose reel hose	30m	As above	MR
	c) Nozzle diameter	5mm	As above	MR
7.	Automatic fire detection and alarming system			
	Provided & Maintained by Mall			
	a) Type of detectors	NA	As above	NA
	b) Location of Main Panel	NA	As above	NA
	c) Location of Repeater Panel	NA	As above	NA
	d) Alternate source of power	NA	As above	NA
	e) Hooters' Location	NA	As above	NA
8.	MOEFA			
		Required	Provided	MR
9.	Public Address System			
		NA	NA	NA
10.	Automatic Sprinkler System			
	Provided & Maintained by Mall			
	a) Basement	NA	As Above	NA
	b) Ground & Upper Floors	NA	As Above	NA
	c) Sprinkler above false ceiling	NA	As Above	NA
11.	Internal Hydrants			
	Provided & Maintained by Mall			
	a) Size of riser/down-comer	Required	As Above	MR
	b) Number of hydrants per floor	Required	As Above	MR
	c) Hose Box	Required	As Above	MR
12.	Yard Hydrants			
	a) Total number of hydrants	NA	NA	NA
	b) Hose Box	NA	NA	NA
13.	Pumping Arrangements			
	• Ground Level	Provided & Maintained by Mall		
	➤ Discharge of main Pump	NA	2280LPM (02 nos.)	NA
	➤ Head of Main pump	NA	70m	NA
	➤ Number of main pumps	NA	02nos.	NA
	➤ Jockey Pump out put	NA	280 & 180LPM	NA
	➤ Jockey pump head	NA	70m	NA
	➤ Standby Pump out put	NA	2280LPM	NA
	➤ Standby Pump Head	NA	70m	NA
	➤ Auto Starting/Manual Stopping	NA	Provided	NA
	➤ Pump House Access	NA	Provided	NA
	Terrace level			
	➤ Discharge of pump	450 LPM	Provided	MR
	➤ Head of the pump	40m	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14.	Captive Water Storage for firefighting			
	Provided & Maintained by Mall			
	• Underground tank capacity	NA	1,00,000 ltrs	NA
	➤ Draw-off connection	NA	As Above	NA
	➤ Fire service inlet	NA	As Above	NA
	➤ Access to tank	NA	As Above	NA
	• Overhead Tank capacity	20,000ltrs	Provided	MR
15.	Exit Signage.			
		Required	Provided	MR

16.	Provision of Lifts.	Provided & Maintained by Mall		
	a) Pressurization of Lift Shaft	NA	As Above	NA
	b) Pressurization of Lift lobby	NA	As Above	NA
	c) Communication In lift Car	NA	As Above	NA
	d) Fireman's Grounding Switch	NA	As Above	NA
	e) Lift Signage	NA	As Above	NA
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area.			
	a) Total Area	NA	NA	NA
	b) Location	NA	NA	NA
19.	Fire Control Room	Provided & Maintained by Mall		
	a) Detector System Panel	NA	As Above	NA
	b) Flow Switch Panel	NA	As Above	NA
	c) PA System Panel	NA	As Above	NA
	d) Battery backup	NA	As Above	NA
	e) Building Floor Plans	NA	NA	NA
20.	Special Fire Protection System for Protection of special Risks, if any:	NA	NA	NA


The fire protection systems provided in the building were randomly checked and found functional at the time of inspection.


Keeping in view of the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules if agreed, the FSC is recommended under rule 35 of Delhi Fire Service Rules 2010. Accordingly, DFA is put up for approval and signatures please.

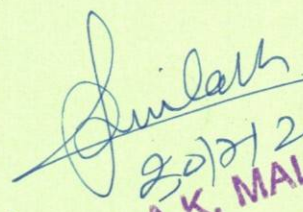
Last Date of Disposal- 11/08/2026.


Signature: 
Name - Sarabjeet Singh
Designation - ADO/ Malviya Nagar

DO (SD)

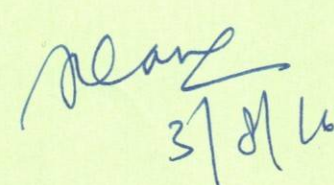
Signature: 
28/7/26
Ravinder Singh


Signature: 

Signature: 
20/8/26
A.K. MALIK


Signature: 


CFO to issue.

Signature: 
31/8/26

Signature: 

Signature: 
5/8/26
A.K. MALIK

Signature: 

Signature: 
5/8/26

Ravinder Singh

D TO

D TO