

c/1145

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110 001.

No. F.6/DFS/MS/School/2026/SZ/ 75

Dated: 25/06/2026

FIRE SAFETY CERTIFICATE

Certified that the Venkateshwar International School located at Sector- 10, Dwarka, New Delhi- 110075, comprised of basement, ground plus 04 upper floors, owned/occupied by Venkateshwar International School. Earlier, the school building was issued FSC by this department vide letter No. F.6/DFS/MS/School/2025/SZ/953 dated 07.08.2025 (for basement, ground plus 03 upper floors only). The building was re-inspected by the officer concerned of this department on dated 25.05.2026 in the presence of Sh. Gautam Mittal, and found that the school building have complied with the fire prevention and fire safety requirements in accordance with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the building/ premises is fit for occupancy class B "Educational Building" (School running up-to 4th floor) with effect from 25/06/2026 for a period of three years in accordance with the Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010, printed below.

Issued on 25/06/2026 at New Delhi.


(A.K. Malik)
Chief Fire Officer
South Zone
25/6/26

Copy to: -

1. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi-110054.
2. The Principal, Venkateshwar International School located at Sector- 10, Dwarka, New Delhi- 75.
3. The Dy. Director (L&I), Building Section, Delhi Development Authority, Vikas Sadan, INA, New Delhi- 110023.

Conditions for the validity of fire safety certificate: -

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. Basement shall be used as per Building Bye Laws.
8. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
9. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form

INSPECTION REPORT

1. Name & address of the building : Venkateshwar International School at Sector- 10, Dwarka, New Delhi- 1975.
2. Type of Occupancy : Educational
3. Building comprised of : Basement, ground plus 04 upper floors
4. Type of Case : Renewal/addition/alteration
5. Details of Previous NOC : F.6/DFS/MS/School/2025/SZ/953 dated 07.08.2025 (B, G+3 floors)
6. Fire Safety directives letter No : F6/DFS/MS/BP/2024/193 dated 13.06.2024 & F6/DFS/MS/BP/2024/370 dated 26.06.2024
7. Date of inspection : 25.05.2026
8. Name of Inspecting Officer : A.D.O. R.K. Yadav (DWK)
9. Name and designation of officers :
From the building side : Sh. Gautam Mittal
10. Year of Construction : 2001 & 4th floor- 2024-25
11. Applicant's letter No. : DDA File No. W10/0169/2023_OCC

Sr. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirements as per NBC-4	Provided at site	Remarks MR/NMR
1.	Access to building			
	- Road width - Gate width - Width of internal road	Accessible 06 m 4.5 m 6.0 m	06 m Provided Provided	MR MR MR
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	- Upper Floors - Basements	04 No's 02 No's	04 No's 02 No's	MR MR
	b. Width of staircases			
	- Upper Floor - Basements	1.50 m each 1.50 m & 1.25 m	Provided 1.5 m & 1.25 m	MR MR
	c. Protection of exits			
	- Fire check door - Pressurization	Required Required	Provided Provided	MR MR
	d. No. of continuous staircases to terrace	04 No's	Provided	MR
	e. Width of Corridor	1.50 m	Provided	MR
	f. Door Size	1.20 m	Provided	MR
3.	Compartmentation			
	- Fire check door - Sealing of electrical shafts - Fire Rating of shaft door - Water Curtain - Fire Dampers	Required Required 02 hours N/A N/A	Provided Sealed Provided N/A N/A	MR MR MR N/A N/A
4.	Smoke Management System			
	- Basements - Upper floors	12 ACPH 12 ACPH	Provided Natural ventilation	MR MR
5.	Fire Extinguishers			
	- Total numbers on each floor - Types - IS marking	01 per 300 m ² ABC/CO ₂ type ISI marked	Provided Provided Provided	MR MR MR
6.	First-Aid Hose Reels			
	- Total numbers - Length of hose reel hose - Nozzle diameter	03 nos. 30 m 5 mm	Provided Provided Provided	MR MR MR
7.	Automatic fire detection and alarming system			

N/32

	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	• Basement	Required	Provided	MR
	• Ground Floor	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	• Size of riser/down-comer	100 mm	Provided	MR
	• Number of hydrants per floor	03 nos.	Provided	MR
	• Hose Box	N/A	Provided	MR
12.	Yard Hydrants			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13.	Pumping Arrangements			
	• Ground Level			
	➤ Discharge of main Pump	2280 LPM	Provided	MR
	➤ Head of Main pump	70 m	Provided	MR
	➤ Number of main pumps	02 nos.	Provided	MR
	➤ Jockey Pump out put	180 LPM	Provided	MR
	➤ Jockey pump head	70 m	Provided	MR
	➤ Standby Pump out put	2280 LPM	Provided	MR
	➤ Standby Pump Head	70 m	Provided	MR
	➤ Auto Starting/Manual Stopping	Required	Provided	MR
	➤ Pump House Access	Required	Provided	MR
	• Terrace level			
	➤ Discharge of pump	900 LPM	Provided	MR
	➤ Head of the pump	40 m	Provided	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14.	Captive Water Storage for fire fighting			
	• Underground tank capacity	1,50,000 ltrs	Provided	MR
	➤ Draw-off connection	Required	Provided	MR
	➤ Fire service inlet	Required	Provided	MR
	➤ Access to tank	Required	Provided	MR
	• Overhead Tank capacity	25,000 ltrs	Provided	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.	No Lift		
	• Pressurization of Lift Shaft	Required	Provided	MR
	• Pressurization of Lift lobby	Required	Provided	MR
	• Communication In lift Car	Required	Provided	MR
	• Fireman's Grounding Switch	Required	Provided	MR
	• Lift Signage	Required	Provided	MR
17.	Standby power supply	Required	Provided	MR


Refuge Area.			
➤ Total Area	N/A	N/A	N/A
➤ Location	N/A	N/A	N/A
19. Fire Control Room			
• Detector System Panel	Required	Provided	MR
• Flow Switch Panel	N/A	N/A	N/A
• PA System Panel	Required	Provided	MR
• Battery backup	Required	Provided	MR
• Building Floor Plans	Required	Provided	MR
20. Special Fire Protection System for Protection of special Risks, if any:	Required	Two Co2 fire extinguisher provided near electric panel	MR

The fire protection systems provided in the building were tested, checked and found not functional at the time of inspection. The shortcomings was issued vide letter No. F6/DFS/MS/School/2026/SZ/253 dated 27.03.2026 have been rectified.

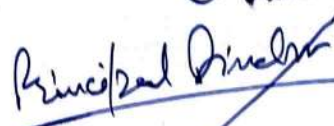
Note: - Earlier, this department issued FSC vide letter No. F.6/DFS/MS/School/2025/SZ/953 dated 07.08.2025 for Basement, ground plus 03 upper floor only. The school building serving with 02 staircases from basement to ground floor with width of 1.50 m and 1.25 m and 04 staircases of 1.50 m each serving from ground floor to terrace and 01 spiral staircase with width of 1.25 m provided at office block.

Keeping in view the compliance of the minimum standards on fire prevention and fire safety required under the rules it is **recommended to grant Fire Safety Certificate** under Rule 35 of the Delhi Fire Service Rule 2010.



Signature of the Inspecting Officer
Name: - R.K. Yadav
Designation: - ADO (DWK)


DO (SW)
3/6/26
RAJINDER ATWAL
CFO (SZ)



4/4/26
A.K. MALIK


Principal


17/06/24


19/6/26
A.K. MALIK

CFO (SZ)


22/6