

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001**

No. F.6/DFS/MS/School/2025/SZ/ **786**

Dated: **13 / 06 / 2025**

**FIRE SAFETY CERTIFICATE**

Certified that the building of **Vidya Bhawan Mahavidyalaya Sr. Sec. School** located at Lodhi Estate, New Delhi-110003 (School ID: 2026038), comprised of Ground + 01 & Two Rear Blks of Ground + 02 upper floors, was issued Fire Safety Certificate by this department vide letter No. F.6/DFS/MS/School/2021/SZ/766 dated 22/09/2021. The premise was re-inspected by the officer concerned of this department on 02/06/2025 in the presence of Capt. Ambar Bagga (Vice Chairman) and observed that said premises have complied with the fire prevention and fire safety requirements in accordance with Director of Education circular No. 262-362 dated 17/01/2005 and that the building/premises is fit for occupancy class "**Educational Group B**" (School) with effect from **13 / 06 / 2025** for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on **13 / 06 / 2025** at New Delhi by

  
**(ATUL GARG)**  
 DIRECTOR  
 Delhi Fire Service

Copy to: -

1. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi-110054
2. The Principal, Vidya Bhawan Mahavidyalaya Sr. Sec. School located at Lodhi Estate, New Delhi-110003

**Conditions for the validity of Fire Safety Certificate:**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working conditions at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire-fighting system.
4. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
5. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, prior to its expiry.
6. The owner/occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)



N-13

INSPECTION REPORT				
1.	Name & address of the building	Vidya Bhawan Mahavidyalaya Sr. Sec. School, Lodhi Estate, New Delhi-110003		
2.	Type of Occupancy	Educational Group-B (School)		
3.	Building Comprised of	Front Blk: Ground + 01 & Two Rear Blks of Ground + 02 upper floors		
4.	Type of Case	Renewal		
5.	Details of previous NOC No.	F.6/DFS/MS/School/2021/SZ/766 Dt. 22/09/2021		
6.	Fire Safety directives Letter No.	DOE Circular 262 to 362 dated 17/01/2005		
7.	Date of inspection	02/06/2025		
8.	Name of the Inspecting Officer	ADO (SJ)		
9.	Name and designation of Officer from the building side	Capt. Ambar Bagga (Vice Chairman)		
10.	Year of Construction	1956		
11.	Applicant's letter No.	VBM/165/2025 dated 26/05/2025 through Outdoor diary No. 2072 dated 26/05/2025		
S. No.	Minimum standards on fire prevention and fire safety U/R 33	Old FSC Requirement	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	Required	18m	MR
	• Gate width	Required	4m & 4.5m	MR
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	Required	02 Nos	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper floors	Required	1.35m & 1.48m	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	Required	One	MR
	e. Width of Corridor	NA	NA	NA
	f. Door Size	1m	Provided	MR
3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke Managements System			
	• Basements	NA	NA	NA
	• Upper floors	NA	NA	NA
5.	Fire Extinguishers			
	• Total numbers	Required	16 Nos	MR
	• Types	ABC & CO <sub>2</sub>	Provided	MR
	• ISI marking	ISI marked	Provided	MR
6.	First-Aid Hose Reels			
	• Total numbers on each floor	One	05 Nos	MR
	• Length of hose reel hose	30m	30m	MR
	• Nozzle diameter	5mm	5mm	MR

*[Signature]*

7.	Automatic fire detection and alarming system			
	• Type of detector	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8.	MOEFA	NA	NA	NA
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	• Basements	NA	NA	NA
	• Upper Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants			
	• Size of riser/down- comer	NA	Provided	NA
	• Number of hydrants per floor	NA	NA	NA
	• Hose Box	NA	Provided	NA
12.	Yard Hydrants			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13.	Pumping Arrangements			
	• Ground Level			
	➤ Discharge of main pump	NA	NA	NA
	➤ Head of main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Staring/Manual stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	450 LPM	450 LPM	MR
	➤ Head of the pump	35m	35m	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14.	Captive water Storage for fire fighting			
	• Underground tank capacity	NA	NA	NA
	➤ Draw of connection	NA	NA	NA
	➤ Fire service inlet	Required	Provided	MR
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	5000 Ltrs	Provided	MR
15.	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	NA	NA	NA
	➤ Pressurization of lift lobby	NA	NA	NA
	➤ Communication in lift Car	NA	NA	NA
	➤ Fireman's Grounding Switch	NA	NA	NA
	➤ Lift Signage	NA	NA	NA
17.	Standby power supply	Required	D.G Set	MR
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA




N-15

19.	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	NA	NA	NA
20.	Special fire protection systems for protection of special risks, if any;	NA	NA	NA

The fire protection systems provided in the premises/building were checked, tested at random and found functional at the time of inspection. The shortcomings issued vide letter No. F.6/DFS/MS/School/2024/SZ/699 dated 11.10.2024 found fully complied.


Keeping in view of the deemed compliance of the minimum standards on fire prevention and fire safety required under the rules, the fire safety certificate issued vide letter No. F.6/DFS/MS/School/2021/SZ/766 dated 22/09/2021, renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended.

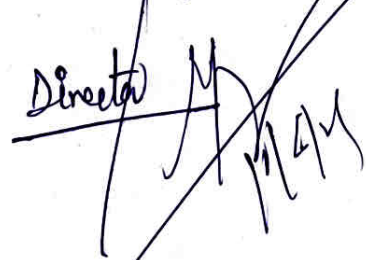
Accordingly, DFA is put up for approval and signature please.

  
Signature of the Inspecting Officer  
Name: Santosh Kumar  
Designation: ADO (SJ)

DO (SD)

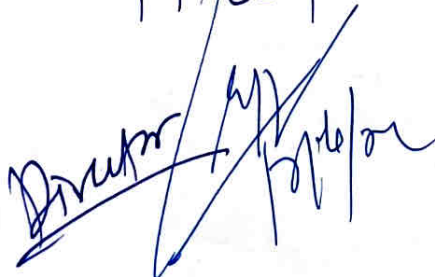
 6/6/25

 9/1/2025

 Director

 11/10/25

Sir, FT letter is pending for your sign. pl

 11/10/25

 11/10/25