

C14

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110 001.

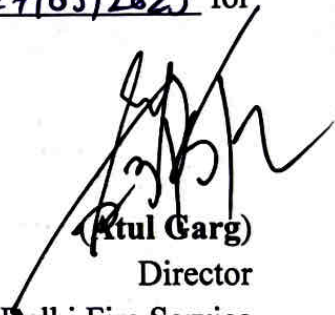
No.F.6/DFS/MS/School/2025/SZ/ 711

Dated: 27/05/2025

FIRE SAFETY CERTIFICATE

Certified that the **Vijay Vidya Niketan (Vijay Vidya Niketan Educational Society)** situated at A-110 A, Sainik enclave, Vikas Nagar, New Delhi-110059, running at ground floor only in a building comprised of ground plus one upper floor, owned/occupied by **Vijay Vidya Niketan Educational Society**, was issued Fire Safety Certificate by this department vide letter No. F6/DFS/MS/School/2021/SZ/957 dated 25.11.2021. The school building was re- inspected by the officer concerned of this department on dated 19.05.2025 in the presence of Anjana Panwar, and found that the school management have deemed complied with the fire prevention and fire safety requirements in accordance with the Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01-03-2011 issued by the Director of Education and that the building/ premises (ground floor only) is fit for occupancy class "Educational Building" w.e.f. 27/05/2025 for a period of three years, subject to compliance of the conditions printed as under.

Issued on 27/05/2025 at New Delhi by.


(Atul Garg)
Director
Delhi Fire Service

Copy to: -

1. The Principal, Vijay Vidya Niketan (Vijay Vidya Niketan Educational Society) situated at A-110 A, Sainik enclave, Vikas Nagar, New Delhi-110059.
2. Director of Education, GNCT of NCT of Delhi, Old Secretariat, New Delhi- 110054.

Conditions for the validity of fire safety certificate: -

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building : Vijay Vidya Niketan (Vijay Vidya Niketan Educational Society), A-110 A, Sainik Enclave, Vikas Nagar, New Delhi-110059.
2. Type of Occupancy : Educational
3. Building Comprised of : G+1 floor, but school running at ground floor only
4. Type of Case : Renewal
5. Details of Previous NOC : F6/DFS/MS/School/2021/SZ/957 dated 25.11.2021
6. Fire Safety directives letter No : N/A
7. Date of inspection : 19.05.2025
8. Name of Inspecting Officer : A.D.O. R.K. Yadav
9. Name and designation of officers
From the building side : Anjana Panwar
10. Year of Construction : 2006
11. Applicant's letter No. : Letter No. Nil dated 24.04.2025

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Dir. Of Edu. Circular dt. 01.03.2011	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none">Road widthGate widthWidth of internal road	Accessible 4.5 m N/A	06 mtrs 2.35 & 1.2 mtrs. N/A	M/R MR, old Case N/A
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	School running at ground floor only		
	<ul style="list-style-type: none">Upper FloorsBasements	N/A	N/A	N/A
	b. Width of staircases	N/A	N/A	N/A
	<ul style="list-style-type: none">Upper FloorBasements			
	c. Protection of exits	N/A	N/A	N/A
	<ul style="list-style-type: none">Fire check doorPressurization			
		N/A	N/A	N/A
		N/A	N/A	N/A
	d. No. of continuous staircases to terrace	N/A	N/A	N/A
	e. Width of Corridor	N/A	N/A	N/A
	f. Door Size	1.0 m	1.05 & 0.85 m	M/R, old case
	3.	Compartmentation		
	<ul style="list-style-type: none">Fire check doorSealing of electrical shaftsFire Rating of shaft doorWater CurtainFire Dampers	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
4.	Smoke Management System			
	<ul style="list-style-type: none">Basements	N/A	N/A	No basement
	<ul style="list-style-type: none">Upper floors	N/A	Natural Ventilation	M/R
5.	Fire Extinguishers			
	<ul style="list-style-type: none">Total numbersTypesIS marking	06 No's ABC/CO2 type ISI marked	Provided	M/R
			Provided	M/R
			Provided	M/R
6.	First-Aid Hose Reels			
	<ul style="list-style-type: none">Total numbers on each floorLength of hose reel hoseNozzle diameter	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A

7.	Automatic fire detection and alarming system			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	• Basement	N/A	N/A	N/A
	• Ground Floor	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	• Size of riser/down-comer	N/A	N/A	N/A
	• Number of hydrants per floor	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
12.	Yard Hydrants			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13.	Pumping Arrangements			
	• Ground Level			
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey Pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/Manual Stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level			
	➤ Discharge of pump	N/A	N/A	N/A
	➤ Head of the pump	N/A	N/A	N/A
	➤ Power Supply	N/A	N/A	N/A
	➤ Auto Starting of pump	N/A	N/A	N/A
14.	Captive Water Storage for fire fighting			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	N/A	N/A	N/A
15.	Exit Signage.	N/A	N/A	N/A
16.	Provision of Lifts. (No Lift)			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A


N/8

17.	Standby power supply	N/A	N/A	N/A
18.	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19.	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested, checked and found not functional at the time of inspection.

Note: - The school running at ground floor only in a building comprised of ground plus one upper floor. 1st floor of the building is not using for teaching purpose at present (as per undertaking placed at C-5).


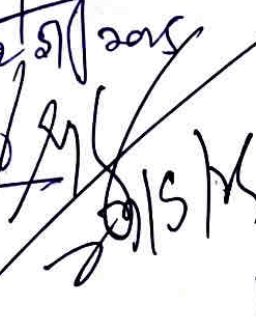
In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the FSC issued vide letter number F6/DFS/MS/School/2021/SZ/957 dated 25.11.2021, renewal in accordance with the Circular No. F.16/Estate/CC/Fire-Safety/2011/3298 to 3398 dated 01.03.2011 issued by the Director of Education is recommended.


Signature of Inspecting Officer
Name: - R.K. Yadav
Designation: - ADO (JKP)

DO (SW)


21/5/25


22/5/2025


22/5/2025
Director

29/5/25
MKN